


**REQUIREMENTS:**

MAINTAIN A RADIUS OF 10' 1:1 SLOPE OF UNDISTURBED SOIL AROUND POLES.

IF TRENCH IS WITHIN THE 1:1 SLOPE THEN A TRENCH SHORING DWG MUST BE SUBMITTED, P.E. STAMPED, FOR NPC APPROVAL.

IF TRENCH IS WITHIN THE PRESCRIBED 10' RADIUS, POLE MUST BE BRACED BY NVE OR NVE CONTRACTOR AT CUSTOMER/DEVELOPER SOLE COST. ADDITIONALLY, TRENCH MUST BE SHORED AS NOTED ABOVE.

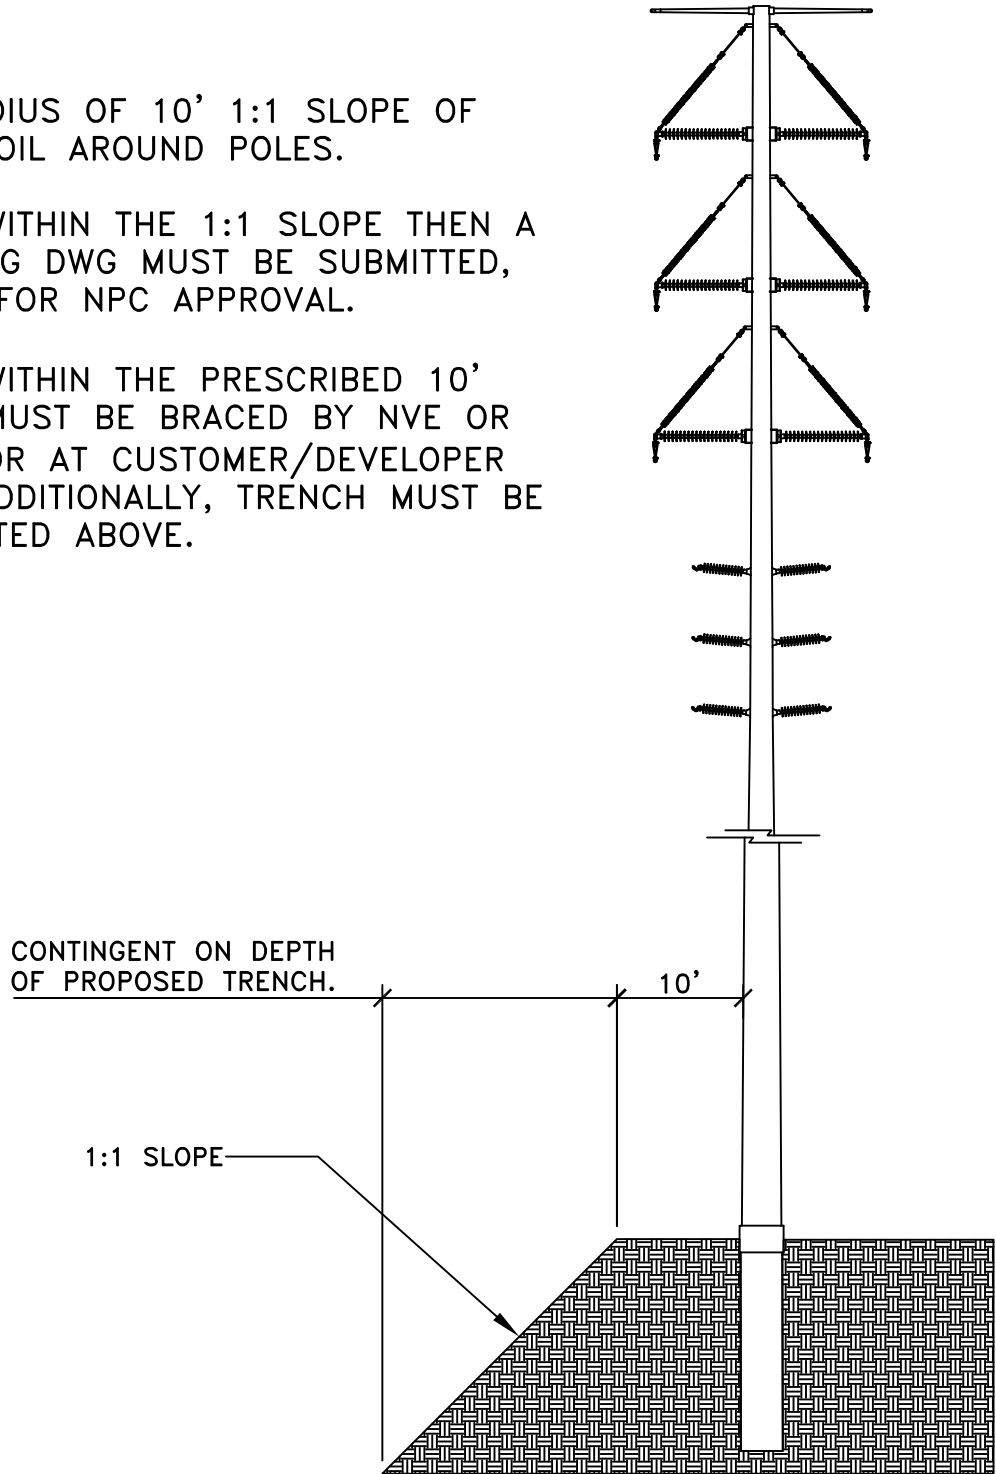

DRAWING INFO.		
DRAWN	6/12/01	JLH
DESIGNED	6/12/01	JLH
CHECKED	6/12/01	SA
APPROVED	6/12/01	SA
	DATE	BY
REV. 1	11/12/08	DP



TRENCH DETAIL POLE STABILITY	
SHEET: 1 OF 1	DWG. NO.: STD-D2