



Clearances

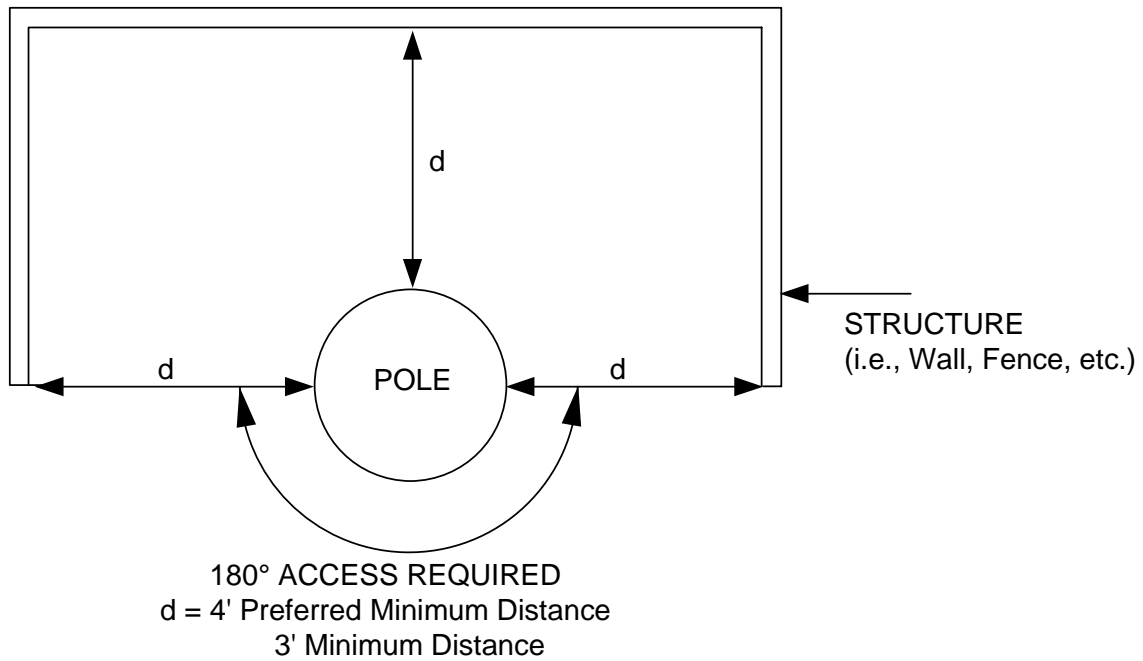


NOTES:

1. NVE Electric Service Requirements RS-5 Property Line Use Requirements shall apply to NVE overhead distribution lines.
2. Specifically, permanent structures are not permitted under or over an NVE easement. Structure designs that interfere with the ingress/egress to and/or the operation and maintenance of overhead distribution lines within an NVE easement are not permitted unless approved by distribution.
3. For guyed structures/poles, the clearance dimension (d) shall include the guy and anchor.
4. All structure designs shall comply with or exceed the requirements of the latest edition or revisions to the NESC.
5. Pole shall be directly accessible from trucks to facilitate the safe removal or replacement of the pole, and the safe operation and maintenance of equipment on the pole.

				Electric Service Requirements		RS-4
				Clearances to Wood Poles		
Drawn:	Eng:	Appr:	Date:			Revision: 1
DH	DH	MES	7/07			Page 1 of 2

Clearances

THIS PAGE INTENTIONALLY LEFT BLANK

 NV Energy				Electric Service Requirements		RS-4
				Clearances to Wood Poles		
Drawn:	Eng:	Appr:	Date:			Revision: 1
DH	DH	MES	7/07			Page 2 of 2