


Equipment Pads

INSTALLATION REQUIREMENTS

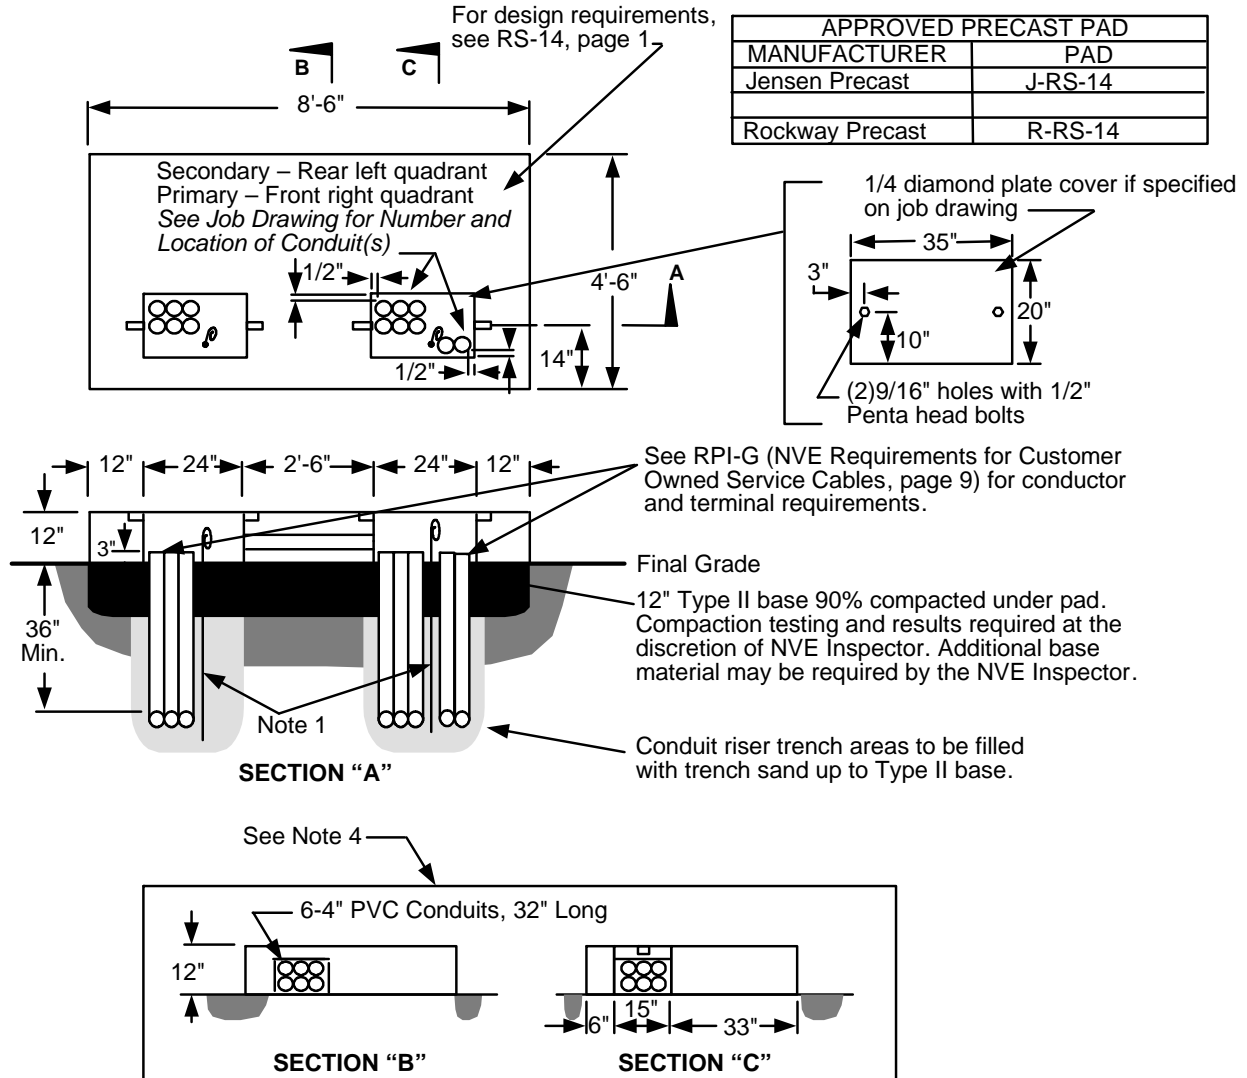


NOTES:

- Grounding by customer shall be 2 - 50' #2 stranded bare copper ground wires laid in the bottom of the conduit trench in opposite directions with 2 - 5' tails in the pad opening.
NOTE: Only at the discretion of NVE's inspectors, a 1/2" x 8' copper ground rod can be installed.
- For location and clearances to other structures, see: RS-5.
- Retaining wall required when grade from bottom of pad rises or lowers more than 1' in 5' horizontally.
- Sections "B" and "C" are for pour-in-place pads only.
- The top of the pad shall be leveled and must clear the final grade by 12".

				Electric Service Requirements		RS-20
				Commercial Transformer Pad: Two 1Ph, 12 or 25kV		
Drawn:	Eng:	Appr:	Date:			Revision: 1
DH	DA	DA	11/06			Page 1 of 2

THIS PAGE INTENTIONALLY LEFT BLANK

 NV Energy.				Electric Service Requirements		RS-20
				Commercial Transformer Pad: Two 1Ph, 12 or 25kV		
Drawn:	Eng:	Appr:	Date:	Revision: 1		
DH	DA	DA	11/06	Page 2 of 2		