


Equipment Pads

INSTALLATION REQUIREMENTS

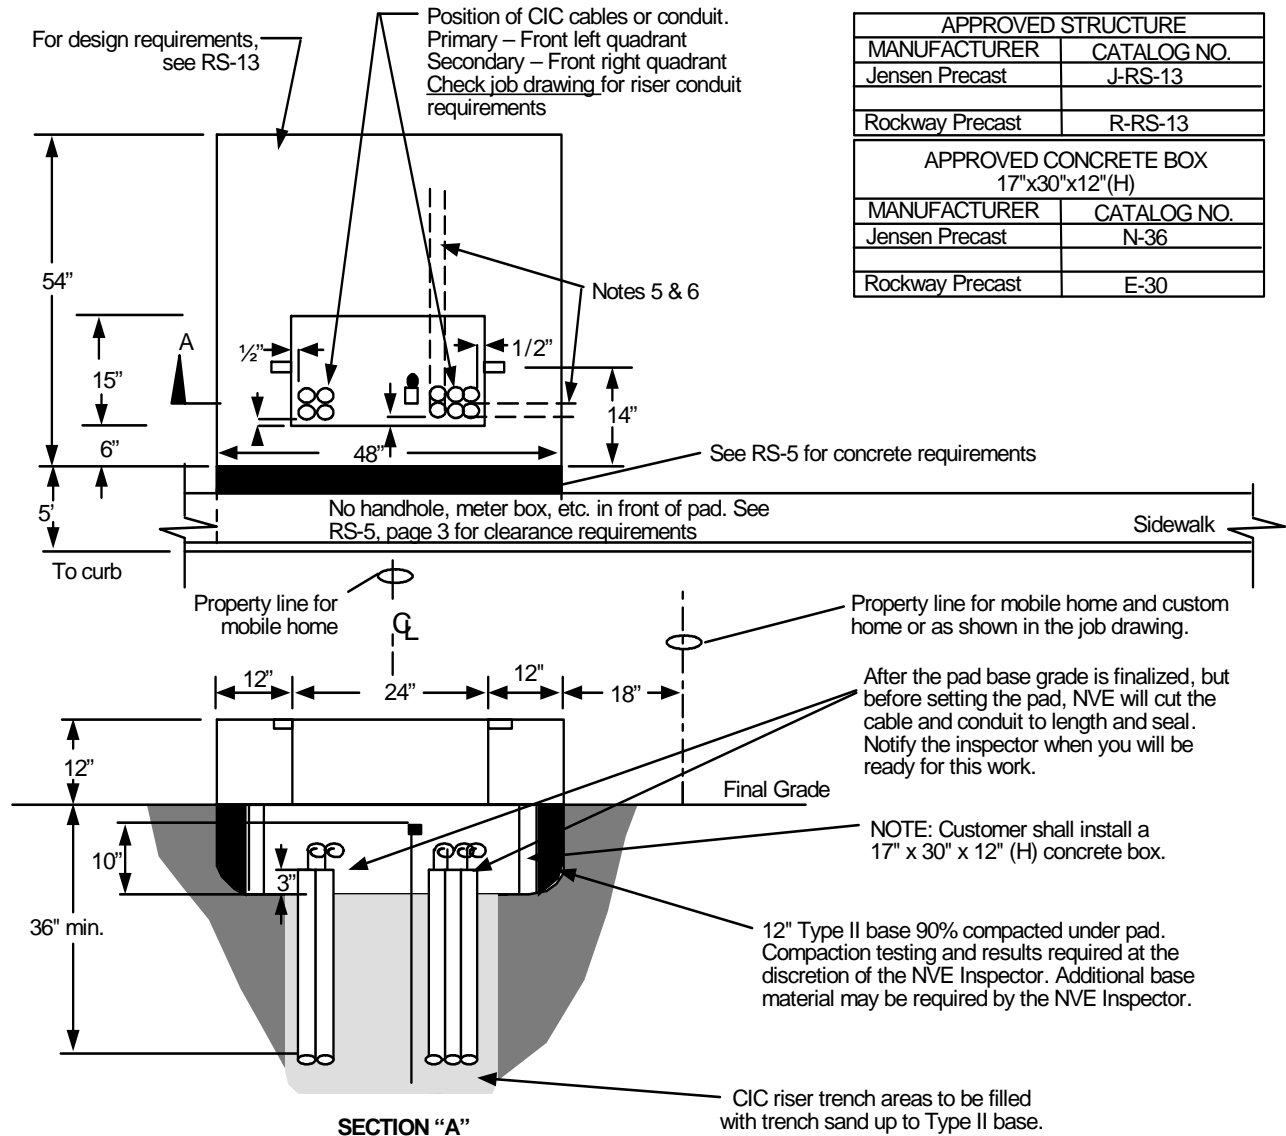


APPROVED STRUCTURE	
MANUFACTURER	CATALOG NO.
Jensen Precast	J-RS-13
Rockway Precast	R-RS-13
APPROVED CONCRETE BOX 17"x30"x12"(H)	
MANUFACTURER	CATALOG NO.
Jensen Precast	N-36
Rockway Precast	E-30

NOTES:

1. Ground rods per UT-121, by NVE.
2. For location and clearances to other structures, see RS-5.
3. Retaining wall required when grade from bottom of pad rises or lowers more than 1' in 5' horizontally.
4. Telephone and cable TV ground wires and clamps shall be installed by them.
5. 3" stubouts must be installed for future homes. Stubouts must clear pad by 6". Depth marker must be installed to locate 3" stubout.
6. 4" DB 60 PVC for 500 kcmil triplex, if required.
7. Stubouts for future services must be placed in front of the other services.

	Electric Service Requirements			RS-28
	Residential Transformer Pad: One 1Ph, 12kV, Phase to Phase			
Drawn: DH	Eng: DH	Appr: DA	Date: 12/06	Revision: 1
				Page 1 of 2

THIS PAGE INTENTIONALLY LEFT BLANK

				Electric Service Requirements		RS-28
				Residential Transformer Pad: One 1Ph, 12kV, Phase to Phase		
Drawn:	Eng:	Appr:	Date:	Revision: 1		
DH	DH	DA	12/06	Page 2 of 2		