


# Trenching

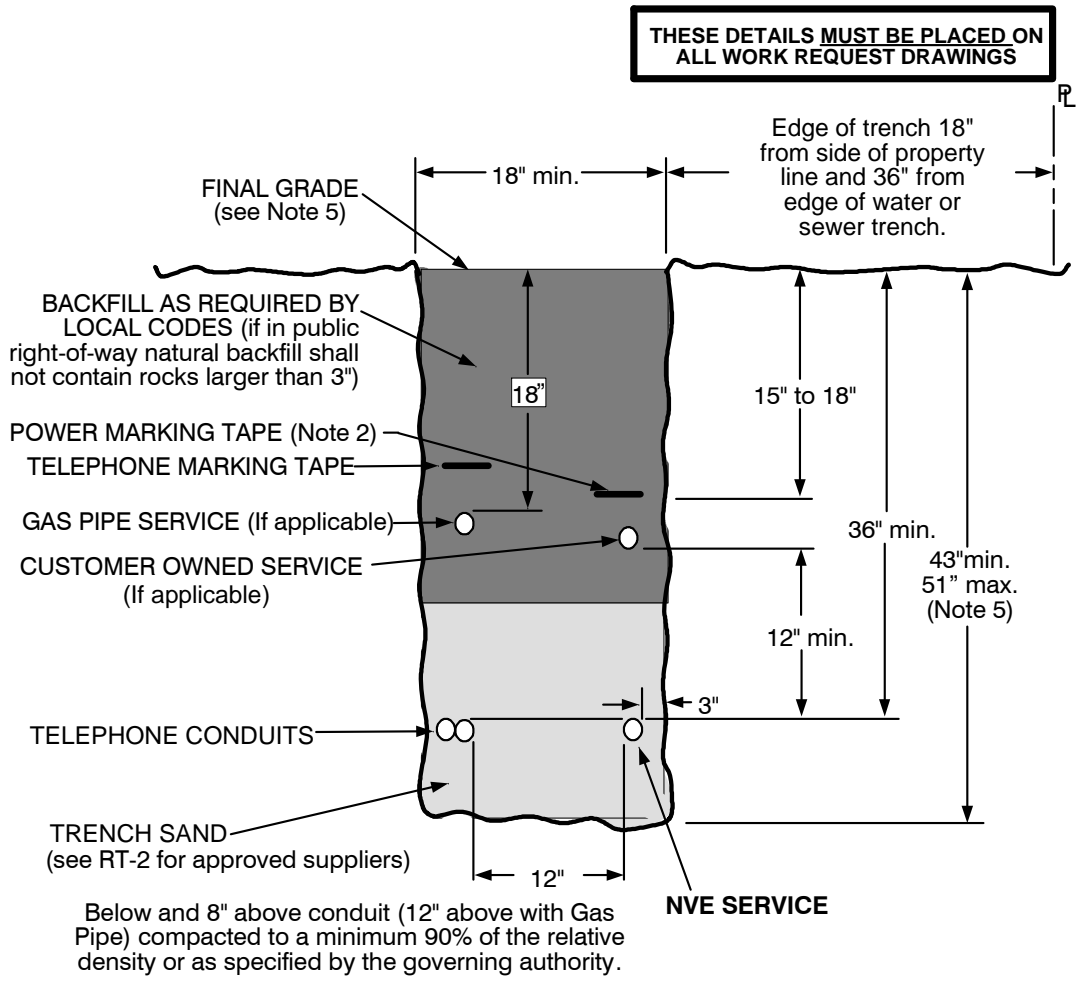

**NOTES:**

1. See RT-G for general requirements, RT-1 for trench, sand, and backfill requirements and RC-1 for conduit material requirements.
2. Vinyl marking tape is provided as supplemental protection because NVE cannot control the final grade elevation due to possible future surface grade changes by the developer or owner.
3. Excavated material shall be placed a minimum of two feet from both edges of the trench to prevent material from falling into the open trench.
4. Service trench shall not be excavated in a slope parallel to the trench.
5. Where the final grade cannot be determined, the trench depth in an undeveloped area shall be determined by the NVE inspector with a minimum trench depth of 5'.

				<b>Electric Service Requirements</b>		<b>RT-8</b>
<b>Trench Detail: Residential Service</b>						
Drawn:	Eng:	Appr:	Date:			Revision: 1
DH	DH	KL	6/07			Page 1 of 2

THIS PAGE INTENTIONALLY LEFT BLANK

 <b>NV Energy.</b>				Electric Service Requirements		RT-8
				Trench Detail: Residential Service		
Drawn:	Eng:	Appr:	Date:	Revision: 1		
DH	DH	KL	6/07	Page 2 of 2		