



Trenching

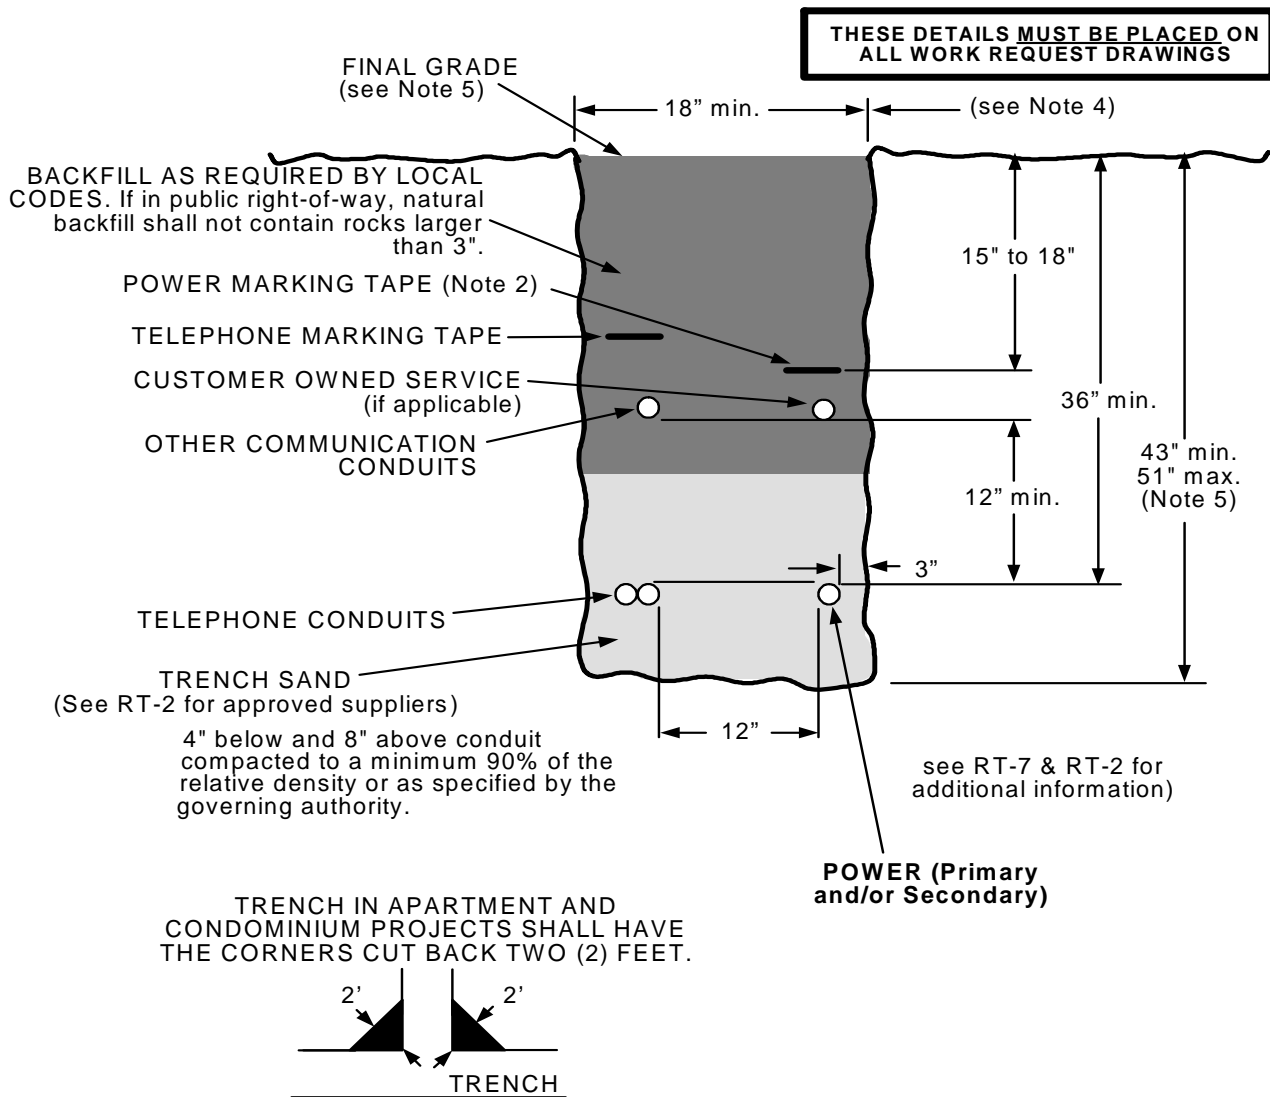


NOTES:

1. See RT-G for general requirements, RT-1 for trench, sand and backfill requirements and RC-1 for conduit material requirements.
2. Vinyl marking tape is provided as supplemental protection because NVE cannot control the final grade elevation due to possible future surface grade changes by the developer or owner.
3. Excavated material shall be placed a minimum of 2' from both edges of the trench to prevent material from falling into open trench.
4. Edges of trench shall be a minimum of 36" from edge of Water, Gas or Sewer pipes.
5. Where the final grade cannot be determined, the trench depth in an undeveloped area shall be determined by the NVE Inspector with a minimum trench depth of 5".
6. For a "sole - use" trench with one conduit only, the trench width may be reduced to two times the nominal diameter of the conduit, but in no case less than 6".

				Electric Service Requirements		RT-12
				Trench Detail: Residential or Commercial		
Drawn:	Eng:	Appr:	Date:			Revision: 1
DH	DH	KL	6/07			Page 1 of 2

THIS PAGE INTENTIONALLY LEFT BLANK

				Electric Service Requirements		RT-12
				Trench Detail: Residential or Commercial		
Drawn:	Eng:	Appr:	Date:	Revision: 1		
DH	DH	KL	6/07	Page 2 of 2		