



# SUBDIVISION PUBLIC UTILITY EASEMENT STAKING DETAIL

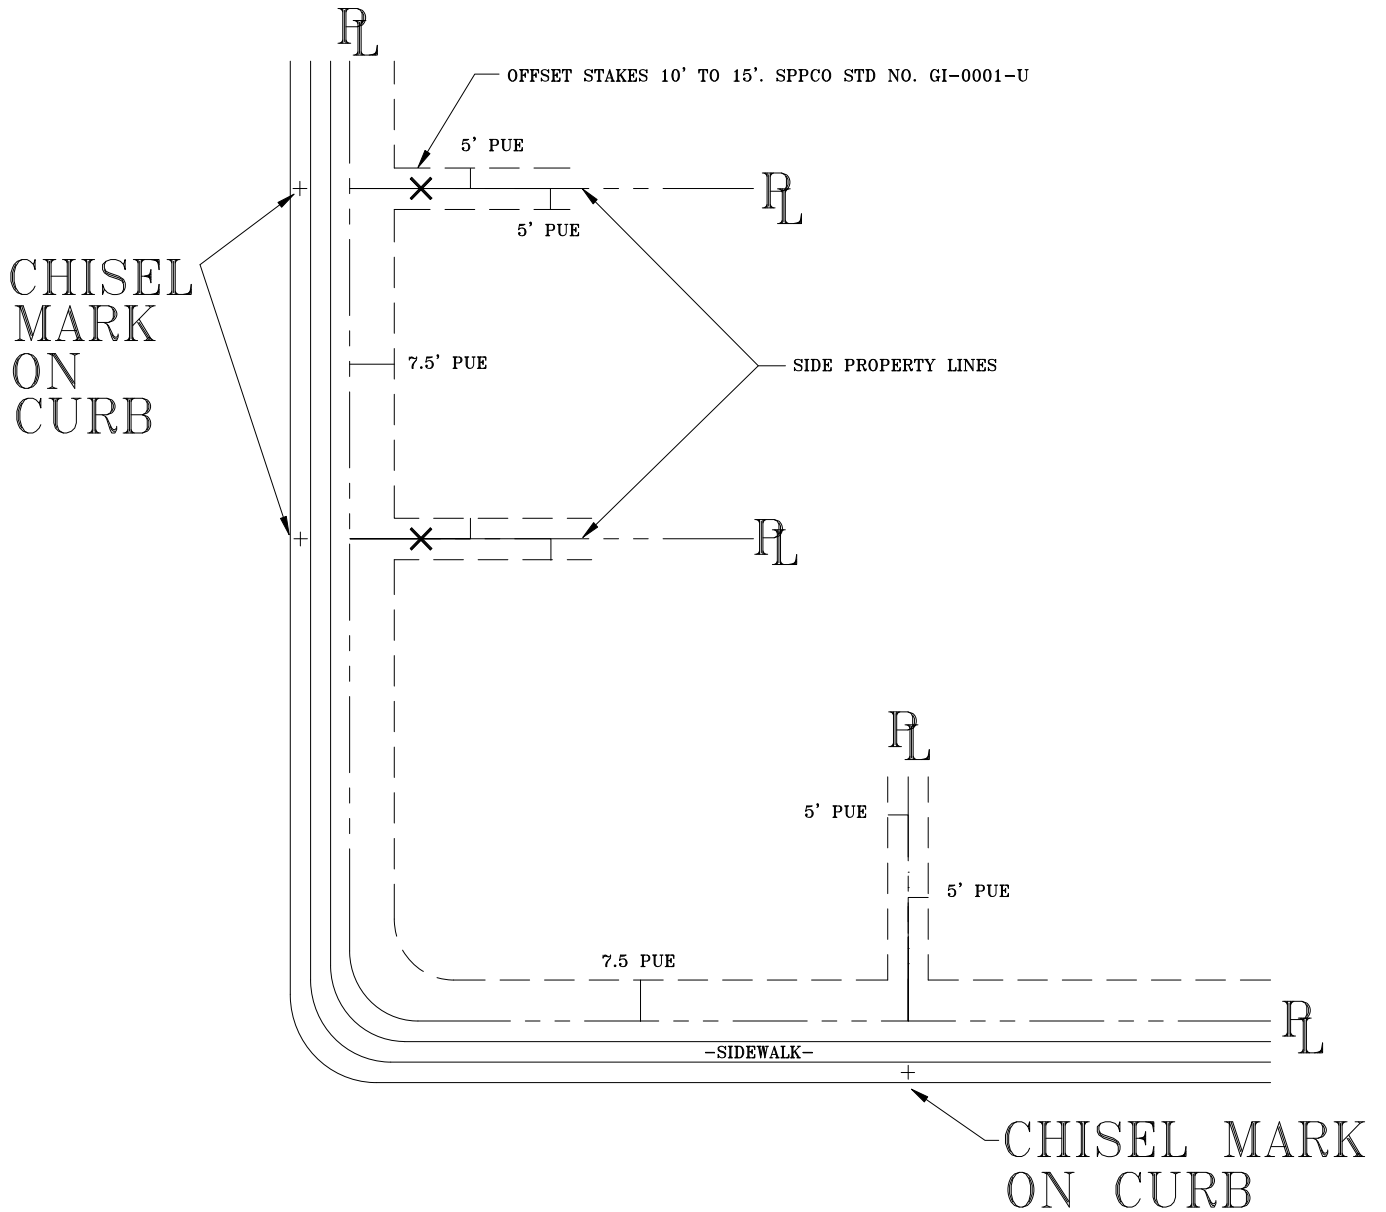

1. APPLICANT TO FURNISH PROPERTY LINE CHISEL MARK ON CURB.
2. FRONT PUE TO BE 7.5', SIDELOT PUE TO BE 5' AND OTHERS AS REQUESTED.
3. OFFSET STAKES 10' TO 15' BY APPLICANT.

 <b>NV Energy</b>	VOLUME 17 – ENGINEERING & CONSTRUCTION STANDARD	<b>GI0002U</b>								
	SUBDIVISION PUBLIC UTILITY EASEMENT STAKING DETAIL	Revision: 6 Page 1 of 1								
<table border="1" style="width: 100%; border-collapse: collapse;"> <tr> <td style="width: 25%;">Drawn:</td> <td style="width: 25%;">Eng:</td> <td style="width: 25%;">Appr:</td> <td style="width: 25%;">Date:</td> </tr> <tr> <td>JL</td> <td>JF</td> <td>SJ</td> <td>5/04</td> </tr> </table>	Drawn:	Eng:	Appr:	Date:	JL	JF	SJ	5/04		
Drawn:	Eng:	Appr:	Date:							
JL	JF	SJ	5/04							