



# ELECTRIC TRENCH / HYDRANT BYPASS DETAIL EXCEPTION SHOWN

**GENERALLY, HYDRANTS WILL BE LOCATED ON OPPOSITE  
SIDE OF STREET FROM ELECTRIC MAIN TRENCH.**

***Note:*** The 48" dimension may vary depending on PUE and R/W requirements. Please contact the local NVE office for exact details.

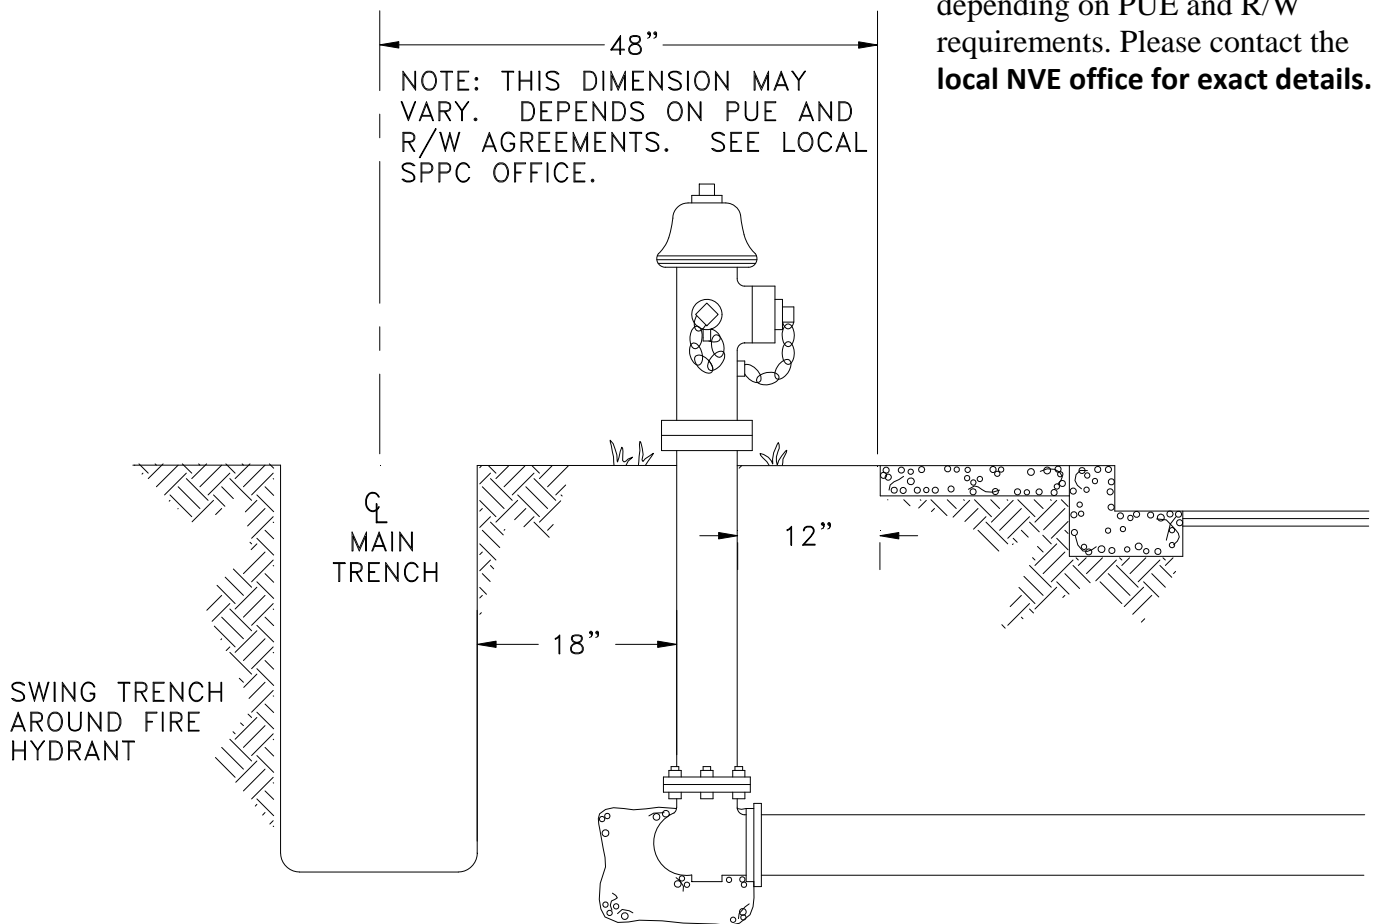

|   |                     |                      |                      |   |  |             |  |
|---|---------------------|----------------------|----------------------|---|--|-------------|--|
|  |                     |                      |                      | VOLUME 17 – ENGINEERING & CONSTRUCTION STANDARD |  | TE0045U     |  |
| <b>ELECTRIC TRENCH HYDRATION BYPASS<br/>DETAIL</b>                                  |                     |                      |                      | Revision: 6                                     |  | Page 1 of 1 |  |
| <small>Drawn:</small>   | <small>Eng:</small> | <small>Appr:</small> | <small>Date:</small> |   |  |             |  |
| JL  | MB                  | DA                   | 5/05                 |   |  |             |  |