


DESIGN REQUIREMENTS


TOLERANCES:

- a = +1/2", -1/2"
- b = +0", -1"
- c = +0", -1/16"

APPROVED INTERCEPT SPLICE BOXES	
MANUFACTURER	INTERCEPT BOXES
Jensen Precast	J-RS-84

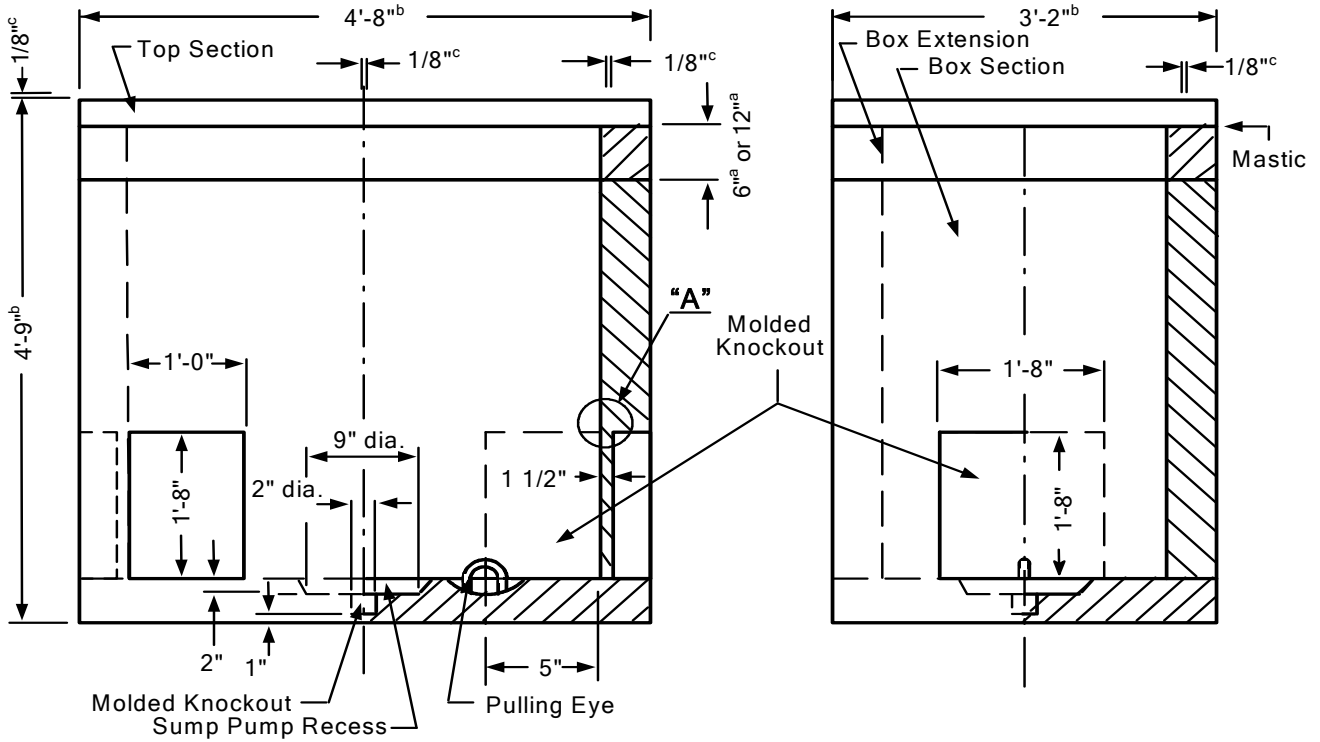

RS-84 INTERCEPT SPLICE BOX



				Electric Service Requirements		RS-84
				Intercept Splice Box: 30" x 48" x 48"		
Drawn:	Eng:	Appr:	Date:	Revision: 3		Page 1 of 6
JR	RD	DA	9/15			

Vaults and Boxes


1. TOP SECTION (WITH TORSION ASSISTED LIDS)

1. "ELE" in 1" letters, centered, bead welded or impressed into the top of one lid section.
2. Two 5/8" slotted holes with 1/2" – 13 UNC stainless steel pentahead bolts, and two 1/2" UNC stainless steel spring nuts placed into two covered channels (struts), which shall be welded continuously to the bottom and side of the frame under the slotted holes.
3. Both lid sections level to the top of the frame.
4. A 1" diameter hole (for a typical lifting hook), in covering lid section, with a permanent internal safety cover.
5. Two stainless steel (filled with grease) or brass bearing hinges for each lid section.
6. Provision(s) to lock each lid in the 90° open position.
7. A maximum 1/8" horizontal and vertical gap around lids, with a debris shield welded on the back side of lids (see Figure 2).



Figure 2.

8. Anchoring provision(s), at both ends of the frame.
9. The frame bolted to the precast extension, and the gap sealed with mastic or similar material approved by NVE.
10. Minimum of one (0.141 sq. in. cross-section) cold galvanized torsion bar (for each lid), held by provision(s) that allow easy bar replacement. Bar material – spring steel (5160H ASQ; heat treated to 42±2 R/C and straightened).
11. Maximum 35lb. pulling force required to open each lid section.
12. The open angle (by torsion bars) not to exceed 15 degrees between the lid and the frame.
13. Intentionally Omitted.
14. Every twentieth top section assembled, tested by opening and closing the lid 25 times.

				Electric Service Requirements		RS-84
				Intercept Splice Box: 30" x 48" x 48"		
Drawn:	Eng:	Appr:	Date:			Revision: 3
JR	RD	DA	9/15			Page 2 of 6

Vaults and Boxes

2. BOX EXTENSION

1. 30" (W) x 48" (L) inside dimensions with tolerances of ± 1 ".


3. BOX SECTION

1. Two 12" (W) x 20" (H) molded knockouts in each side wall.
2. One 20" (W) x 20" (H) molded knockouts in each end wall.
3. A 9" diameter x 2" deep sump pump recess with 2" diameter knockout in the middle of the floor.
4. All knockouts with $\frac{1}{2}$ " notch around each knockout in middle section per detail "A" on page 1.
5. 30" (W) x 48" (L) inside dimensions with tolerances of ± 1 ".
6. Two steel pulling eyes in the floor.

4. ENTIRE STRUCTURE


1. All exposed steel shall be hot dip galvanized after fabrication, except torsion bars.
2. Torsion bars shall be spray galvanized.
3. Shall meet RS-G2 and RS-G4.

NOTE: For traffic areas, (e.g., streets, roads, etc) use the RS-83 box.

	Electric Service Requirements			RS-84
	Intercept Splice Box: 30" x 48" x 48"			
Drawn:	Eng:	Appr:	Date:	Revision: 3
JR	RD	DA	9/15	Page 3 of 6

Vaults and Boxes


INSTALLATION REQUIREMENTS

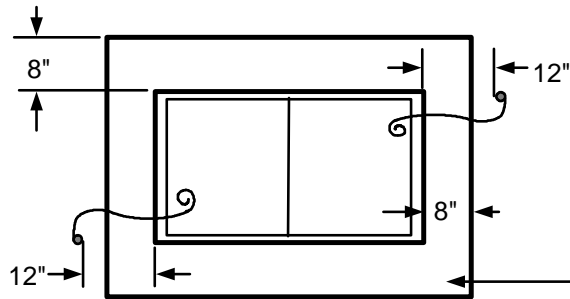

APPROVED INTERCEPT SPLICE BOXES	
MANUFACTURER	INTERCEPT BOXES
Jensen Precast	J-RS-84


GRAVEL, GRASS, OR BARE GROUND INSTALLATION

For gravel, grass, or bare ground installation, concrete an 8" wide by 6" deep collar around the splice box according to RS-G6.

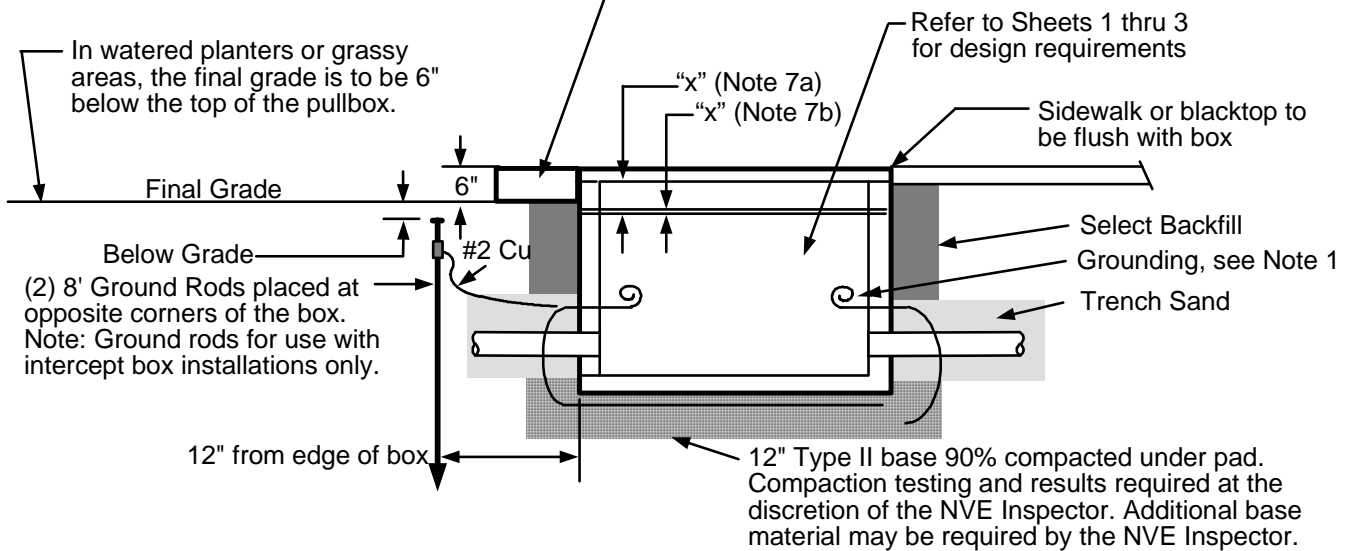

NOTES:

1. Grounding by customer, shall be one of the following:
 - A. 2-50' lengths of #2 stranded bare copper wire laid in trench with 5' tails in the box.
 - B. Only at the discretion of the NVE Inspector, two 1/2" x 8' copper clad ground rods placed at opposite corners of the box may be installed.
- * Grounding in accordance with the 2012 NESC C2-2012 Section 9, Grounding Methods for Electric Supply and Communications Facilities or latest version.
2. The bottom surface of the manhole shall be level.
3. If the ground water level is at least 3' below the bottom of the pull box, the 2" diameter knockout in the sump pump recess shall be removed.
4. To protect the cable, a 4" split conduit shall be placed over the direct buried 1/0 cable before grouting the box.
5. Intentionally Omitted.

				Electric Service Requirements		RS-84
				Intercept Splice Box: 30" x 48" x 48"		
Drawn:	Eng:	Appr:	Date:	Revision: 3		Page 4 of 6
JR	RD	DA	9/15			


Vaults and Boxes

- 6. Knockouts shall be removed from the inside of the structure.
- 7. If any final grade adjustments “x” are needed, take the actions listed in Table 1.


Table 1. Adjustment Requirements

Adjustment	Action
-6” to +5”	NVE contractor shall exchange existing 12” extension with 6” to 17” high extension ordered from the original manufacturer.
+6” to +12”	NVE contractor may order an additional 6” to 12” height extension from original manufacturer.
Below -6” & above 12”	Any extension shorter than 6” or exceeding 12” in height shall be subject to T&D Standards department approval.

- 8. This box may be installed in sidewalks or in delivery alleys behind commercial developments.
NOTE: For traffic areas, (e.g. streets, roads, etc.) use the RS-83 box.
- 9. There shall be a minimum 6’ clearance from the RS-84 box to the centerline of a fire hydrant.
- 10. Retaining wall required when grade from the top of the lid rises or lowers more than 1’ in 5’ horizontally or when required by developer as perimeter wall.

				Electric Service Requirements		RS-84
				Intercept Splice Box: 30” x 48” x 48”		
Drawn:	Eng:	Appr:	Date:			Revision: 3
JR	RD	DA	9/15			Page 5 of 6

THIS PAGE INTENTIONALLY LEFT BLANK

				Electric Service Requirements		RS-84
				Intercept Splice Box: 30" x 48" x 48"		
Drawn:	Eng:	Appr:	Date:	Revision: 3		
JR	RD	DA	9/15	Page 6 of 6		