


Vaults and Boxes

INSTALLATION REQUIREMENTS

APPROVED STRUCTURES		
MANUFACTURER	PAD	MANHOLE
Jensen Precast	J-RS-58	J-RS-97

A 4" thick concrete slab is required when the equipment pad is located in a grassy area, planter, or bare ground. The slab must be finished to final grade and constructed per RS-G6.

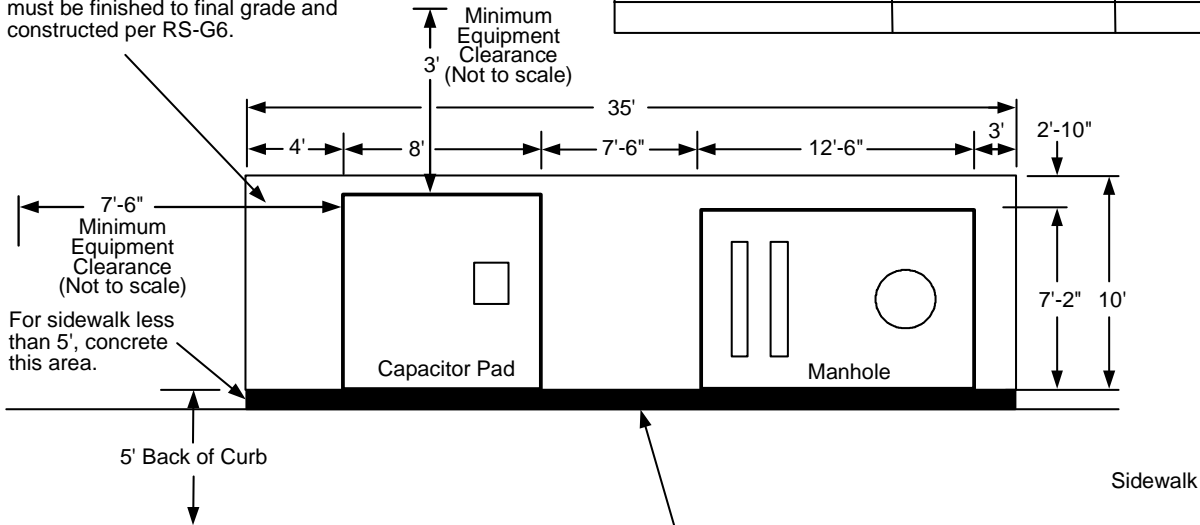

Ensure that hole is lined up with manhole wall.

Fill this area with concrete if a gap exists between the capacitor pad manhole pad and the sidewalk. See RS-G6 for additional information.

On a site with a sloping grade, each pad is set level to its own final grade with a slab set to conform with the sloping grade.

Final Grade

4" Type II base 90% compacted under slab. Additional base material may be required by the NPC Inspector.

Conduits in trench sand or concrete per job drawing.

12" Type II base 90% compacted under manhole. Compaction testing and results required at the discretion of the NVE Inspector. Additional base material may be required by the NVE Inspector.

7'-6" Minimum Equipment Clearance (Not to scale)

See RS-58 for capacitor pad design and installation requirements

Handhole to have cover

3' Minimum Equipment Clearance (Not to scale)

Conduits must be installed from the bottom up. The first conduit goes into space 1, the second into space 2, etc. The designer avoid designs where future cable will be pulled in under energized cable. The manhole will be rejected by the NVE Inspector if the conduits are not found in the correct locations.

See RS-97 for manhole design and safety requirements


4" PVC

	Electric Service Requirements			RS-112
	25kV Manhole Pad and Capacitor Pad: Adjacent to Public R.O.W.			
Drawn: KT	Eng: RD	Appr: DA	Date: 06/16	Revision: 3
				Page 1 of 2

Vaults and Boxes

NOTES:

1. Grounding by customer shall be 2-50' #2 stranded bare copper ground wires laid in the bottom of the conduit trench in opposite directions with 2-5' tails left in the box.
NOTE: Ground wires shall be installed through a 1" PVC conduit in the structures end walls.
2. For location and clearances to other structures, see RS-5.
3. Retaining wall required when grade from bottom of pad rises or lowers more than 1' in 5' horizontally or when required by developer as perimeter wall.
4. Required easement:

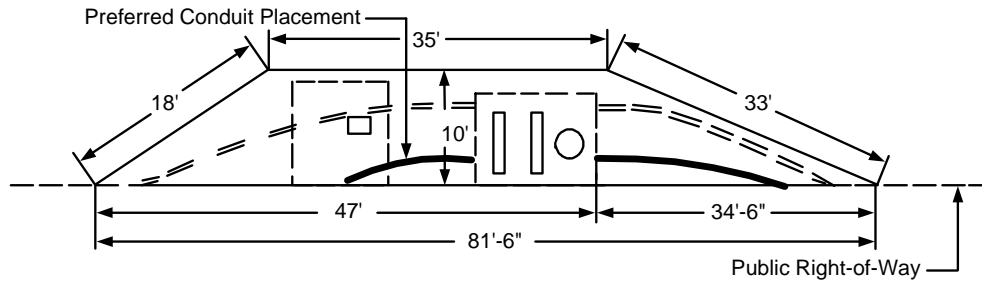

5. If the designer specifies additional conduit openings, the contractor shall core drill the holes as required.
6. The bottom surface of the manhole shall be level.
7. If the ground water level is at least 3' below the bottom of the pull box, the 2" diameter knockout in the sump pump recess shall be removed.
8. If any final grade adjustment "x" is needed, take the actions listed in Table 1.

Table 1. Adjustment Requirements

Adjustment	Action
0" – 6"	The top of the pad has to clear the final grade 11" to min. 5"
6" – 24"	The NVE contractor shall order an extension from the original manufacturer.
Above 24"	Any extension exceeding 24" shall be subject to T & D Standards approval

9. If bottom of the manhole pad is located 1" to 24" above final ground level, the NVE contractor shall make a concrete collar that fills the space under the outside dimensions of the pad.
10. If bottom of the manhole pad is located more than 24" above or below Ground level, the proposed adjustment shall be subject to Regional Standards approval.
11. This manhole may be installed next to sidewalks, but never under traffic areas.
NOTE: For heavy frequency traffic areas, (e.g. streets, roads, etc.) use the RS-94 manhole.