



Trenching

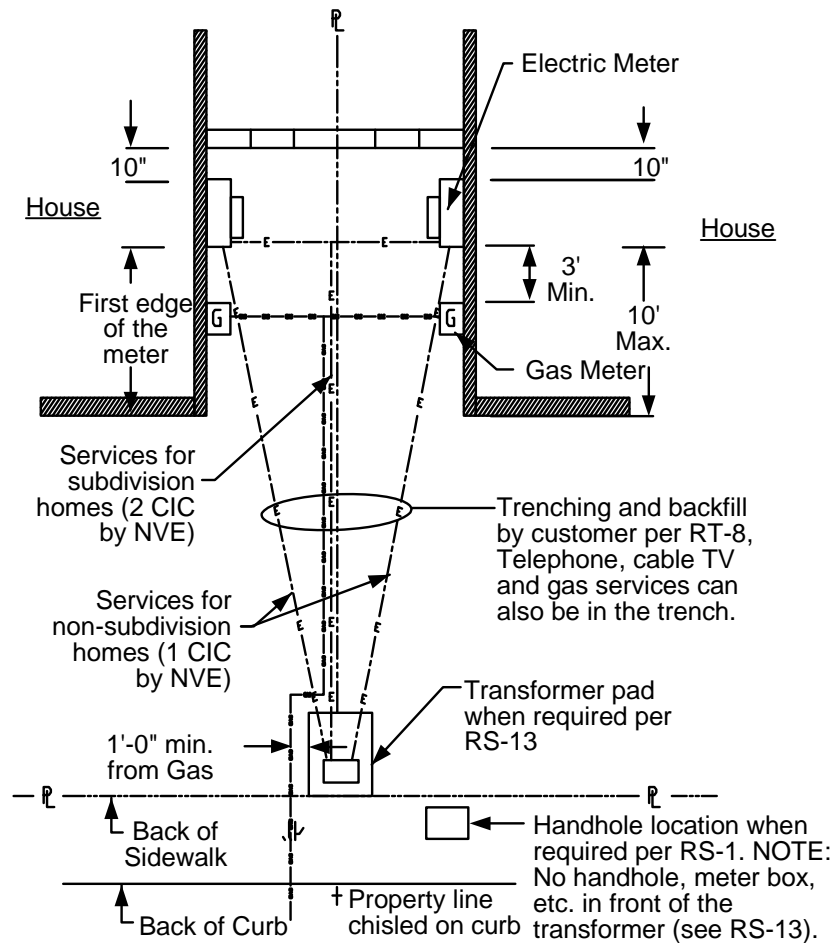


NOTES:

1. NVE will furnish and install a CIC service and connect to the customer's service entrance. It will also furnish and install the meter.
2. The customer shall install the meter/service equipment on the building in accordance with the applicable City or County requirements prior to the excavation of the trench.
3. The trench shall be installed in accordance with RT-1 and RT-8.
4. The customer is required to notify the company at least 48 hours in advance when the trench is ready for inspection. Under no circumstances will the service be installed prior to the Inspection of the meter/service equipment.
5. The trenching and select backfill is provided by the customer.
6. The vinyl marking tape will be provided by NVE and installed by the customer per RT-G.
7. The preferred location of the subdivision trench is left of the property line looking from the street. One exception is if there is a slope, then refer to the slope trench detail by the Designer.
8. The vinyl marking tape will be provided by NVE and installed by the customer per RT-G.

				Electric Service Requirements		RT-6
				Trench: Residential Service Location		
Drawn:	Eng:	Appr:	Date:			Revision: 2
DA	ME	KL	04/08			Page 1 of 2

THIS PAGE INTENTIONALLY LEFT BLANK

				Electric Service Requirements		RT-6
				Trench: Residential Service Location		
Drawn:	Eng:	Appr:	Date:	Revision: 2		
DA	ME	KL	04/08	Page 2 of 2		