



Meeting Attendees and Agenda

NV Energy Reid Gardner Station Mesa Ponds M5 and M7 and Raw Water Ponds Emergency Action Plans

Presented By: Tony Garcia, NV Energy Manager, Environmental Services

Meeting date/Time: March 23, 2022 – 09:30 AM – 10:30 AM

Location: Teleconference via Teams

Invited Attendees:

Solome Barton – City of North Las Vegas – **Absent**
Andrea Webster – Clark County – Present
Jodi Carl – Las Vegas Metropolitan Police Department – **Absent**
Stephen Neel – Moapa Valley Fire District – **Absent**
Misty Richardson – Clark County – **Absent**
Billy Samuels – Clark County – **Absent**
Carlito Rayos – Clark County – **Absent**
Kevin Krencik – NVE – **Absent**
Marcus Dunn – NVE – **Absent**
Todd Robison – NVE – Present
Kimberly Ferguson – NVE – **Absent**
Jason Hammons – NVE – Present
Mathew Johns – NVE – **Absent**
Michael Rojo – NVE – **Absent**
Eugene Logue – NVE – **Absent**
Timothy Hill – NVE – Present
Jennifer Schuricht – NVE – Present

Agenda:

1. History and Demolition Update
2. Overview of Emergency Action Plan (EAP)
3. Emergency Classifications
4. Impacted Area Map – Theoretical
5. Incident Response Process
6. Roles & Responsibilities




CUSTOMER SERVICE



EMPLOYEE COMMITMENT



ENVIRONMENTAL RESPECT

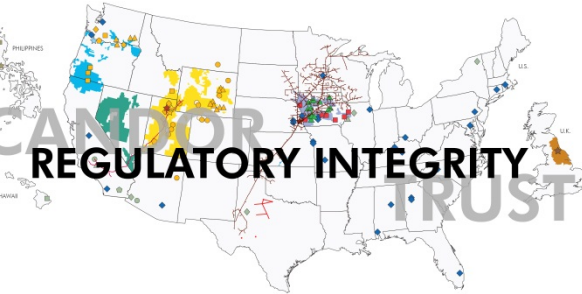

REGULATORY INTEGRITY



OPERATIONAL EXCELLENCE



**BERKSHIRE
FINANCIAL STRENGTH
OWNERSHIP**

Reid Gardner Dam Safety Emergency Action Plan (EAP) Annual Meeting – March 23, 2022

Reid Gardner Station

EAP Annual Meeting Agenda

1. Introductions
2. History and Demolition Update
3. Overview of Emergency Action Plan (EAP)
4. Emergency Classifications
5. Impacted Area Map – Theoretical
6. Incident Response Process
7. Roles & Responsibilities

Reid Gardner Station History and Demolition Update



Unit #1

Online:	June 1965
Retired:	December 2014

Unit #2

Online:	June 1968
Retired:	December 2014

Unit #3

Online:	May 1976
Retired:	October 2014

Unit #4

Online:	July 1983
Retired:	March 2017




March 22, 2022



Reid Gardner Station

Remaining Facilities After Demolition

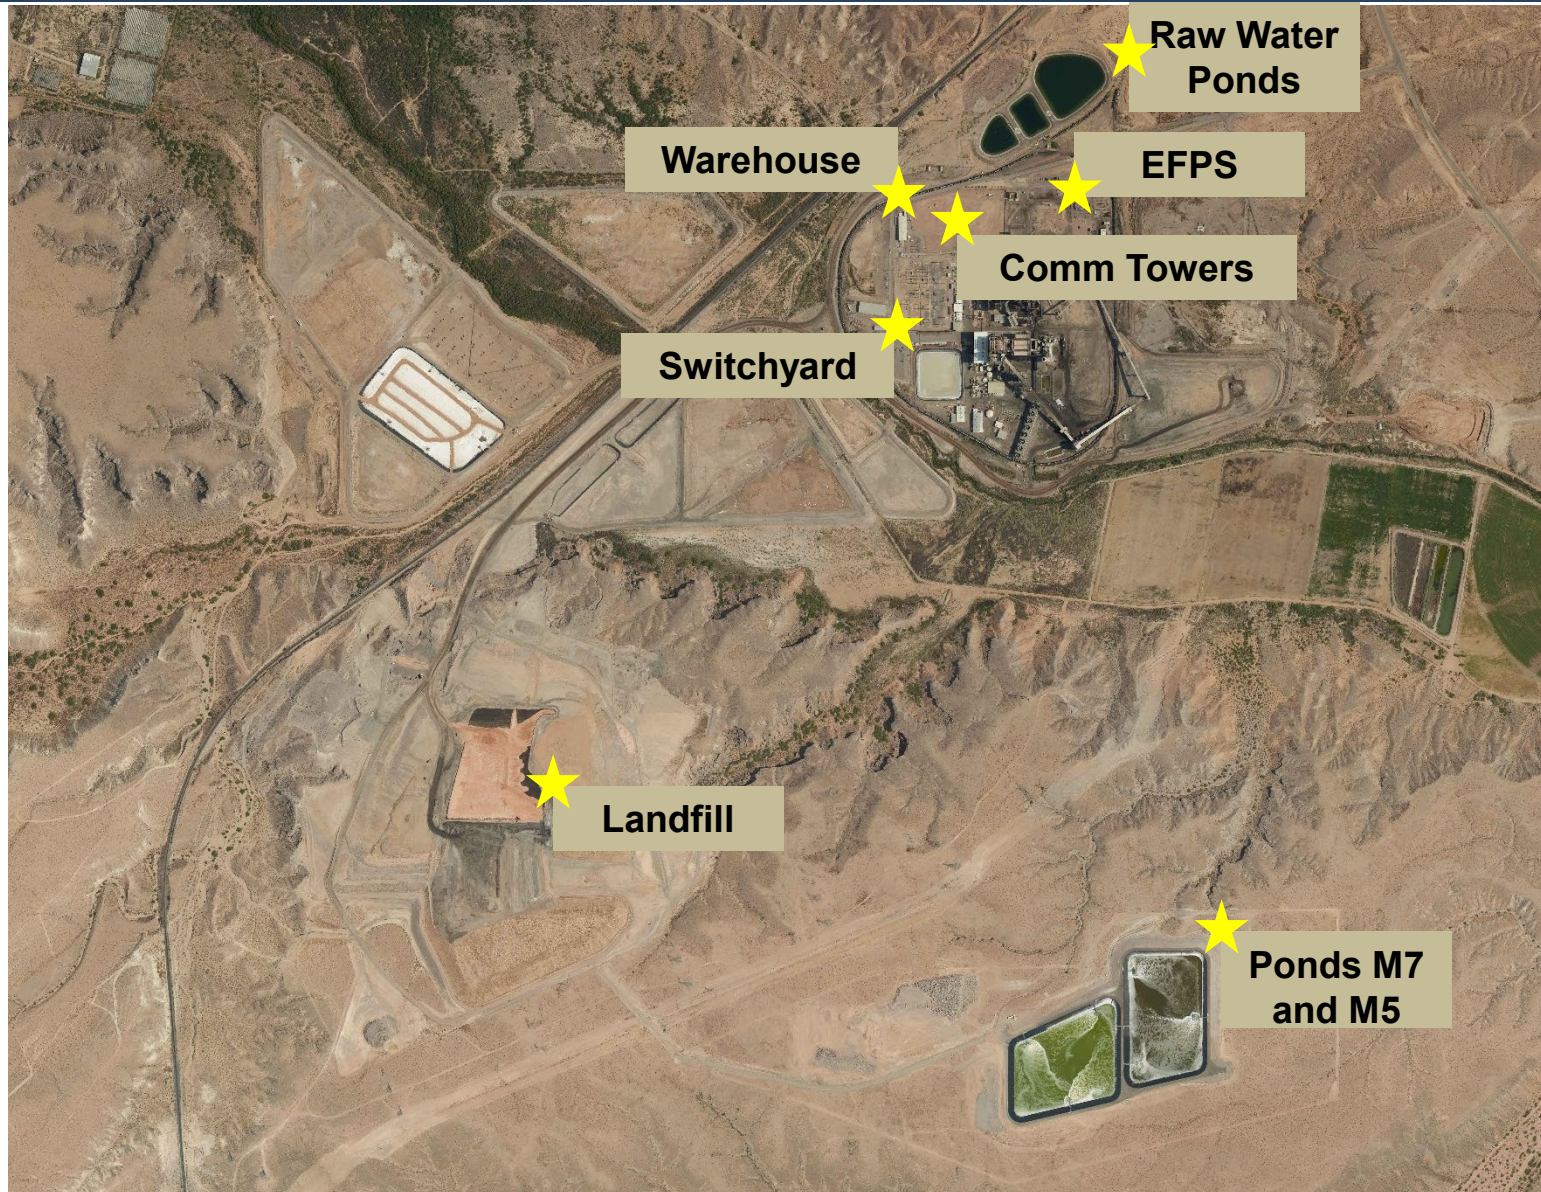

Emergency Action Plan – M5, M7 & Raw Water Ponds

Required by Regulation

- NAC 535.320 and 40 CFR 257.73 (CCR Rule)

Intent of EAP

- Train and assist employees and ER teams in the preparation and response to a dam-safety emergency at the ponds.

FINAL

Emergency Action Plan
Reid Gardner Generating Station
Mesa Ponds M5 and M7

Prepared for
NV Energy

April 2017

ch2m

Pond Name	National Inventory of Dam Number	Nevada State Identification Number
Raw Water Pond A	NV10744	J-633
Raw Water Pond B	NV10787	J-634
Unit 4 Raw Water Pond	NV10788	J-635

Prepared for
NV Energy




May 2018

ch2m

Pond Name	National Inventory of Dam Number	Nevada State Identification Number
Raw Water Pond A	NV10744	J-633
Raw Water Pond B	NV10787	J-634
Unit 4 Raw Water Pond	NV10788	J-635

Document Control No. ____ of ____



Emergency Classifications

Scenario	Conditions	Response
Non-Failure 	<ul style="list-style-type: none"> • water level > operational level, • minor seepage, cracking, sinkholes 	<ul style="list-style-type: none"> • Engage internal experts for evaluation, monitoring and response
Potential Failure 	<ul style="list-style-type: none"> • Increasing discharge from seepage, cracks, • Water releasing from damaged structures, damaged piping • Verified security threats that if carried out could result in damage to the ponds 	<ul style="list-style-type: none"> • Engage emergency responders for preparation and coordination • Engage dam-safety experts to evaluate actions to prevent failure or reduce impacts
Imminent Failure 	<ul style="list-style-type: none"> • Erosion of crest by large overtopping waves, water level overtopping top of berm • Rapidly progressing seeps, sinkholes, slides of embankment slopes 	<ul style="list-style-type: none"> • immediately initiate evacuations • Make emergency notifications • Engage dam-safety experts to evaluate actions to delay failure or reduce impacts

Ponds under the EAP






Raw Water Ponds

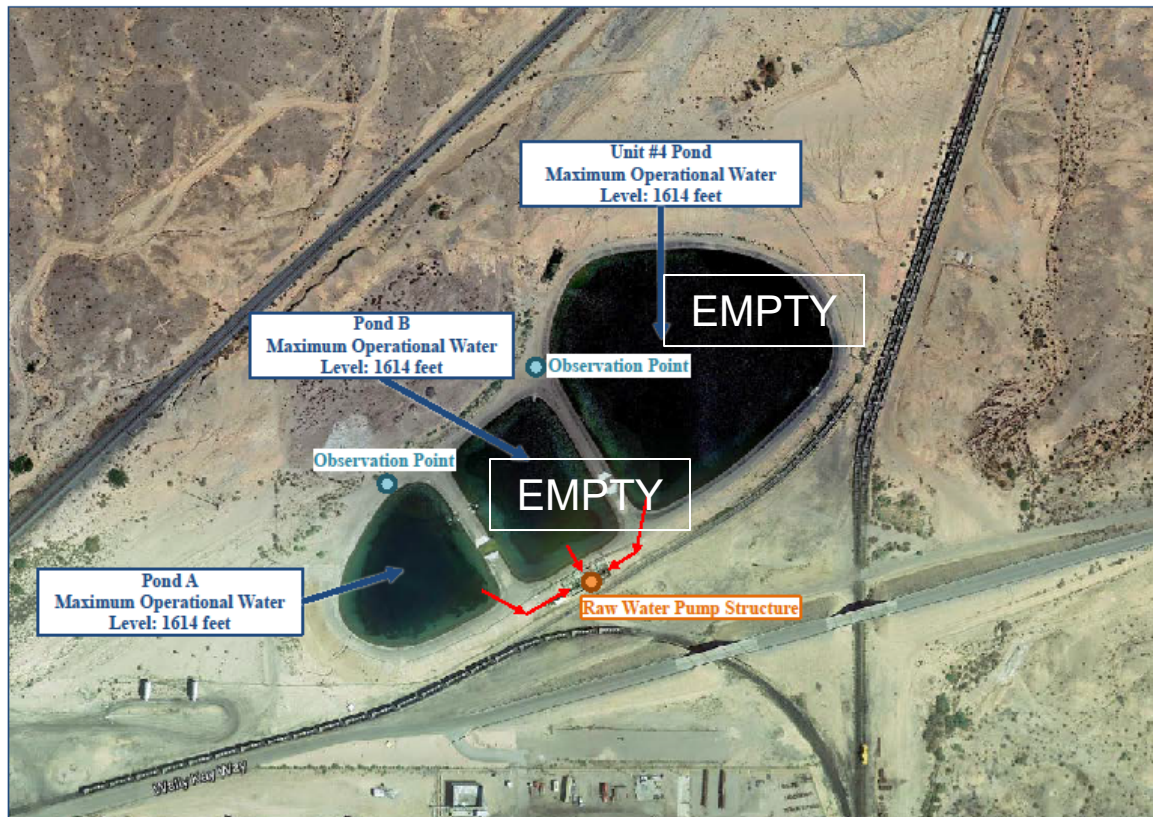


Note: All elevations reference NAVD 1988 vertical datum

Figure 4-2
Dam Facilities Map
Raw Water Ponds
Dam Facilities and Hydraulic Information
Emergency Action Plan
Reid Gardner Station
Moapa, Nevada

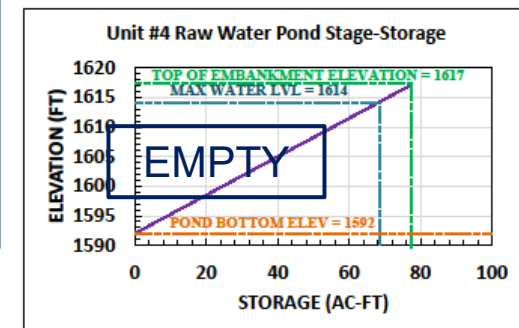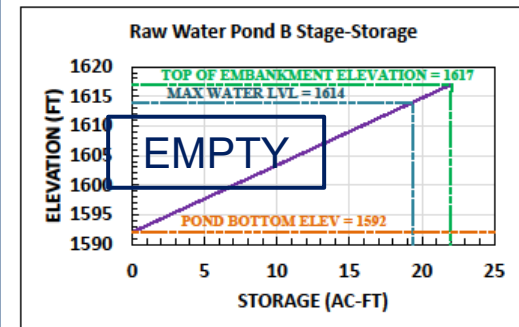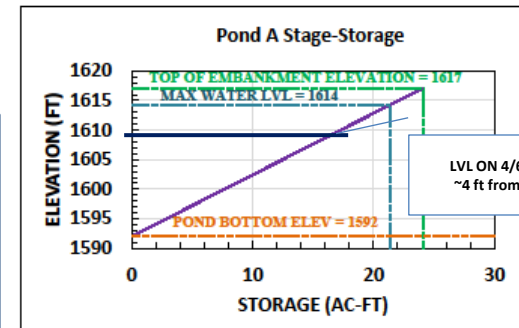

Ponds M5 and M7



Note: all elevations reference NAVD 1988 vertical datum




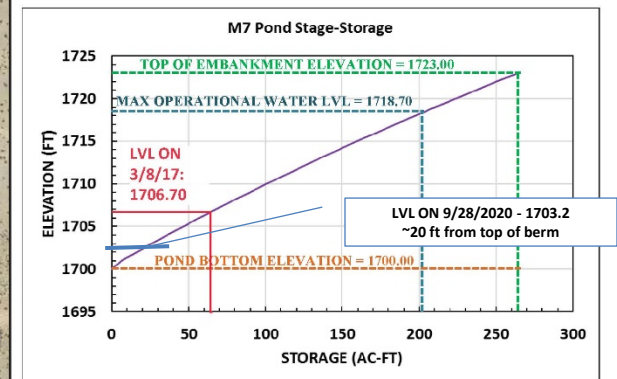


Figure 4-2
 Dam Facilities Map
 Mesa Ponds M5 and M7
 Dam Facilities and Hydraulic Information
 Emergency Action Plan
 Reid Gardner Station
 Moapa, Nevada

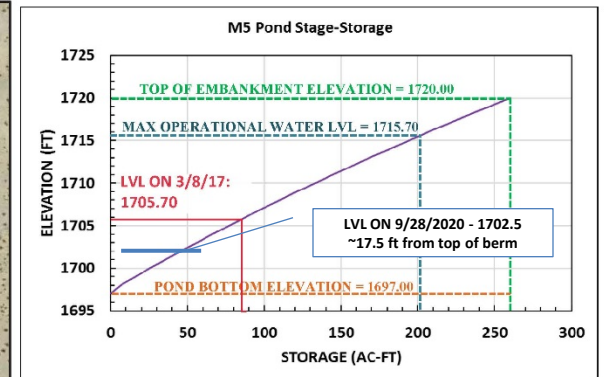

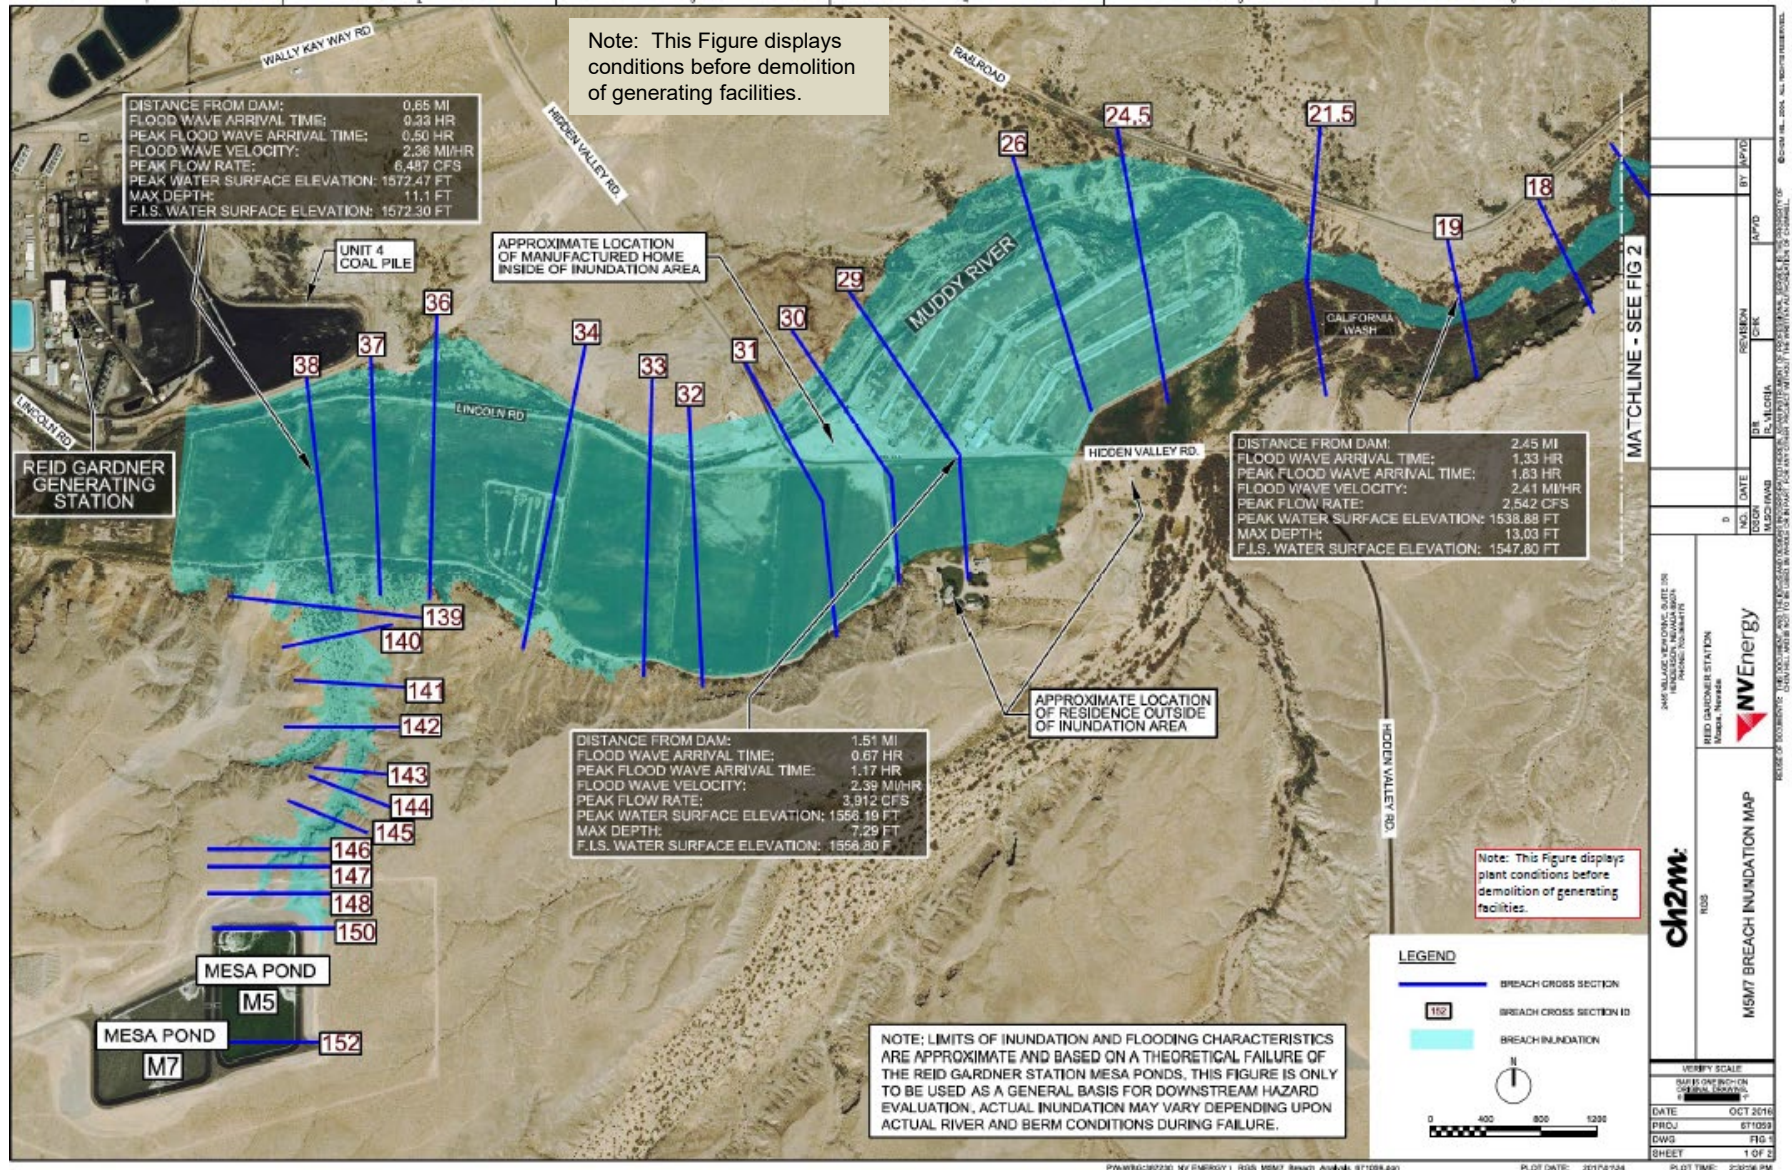

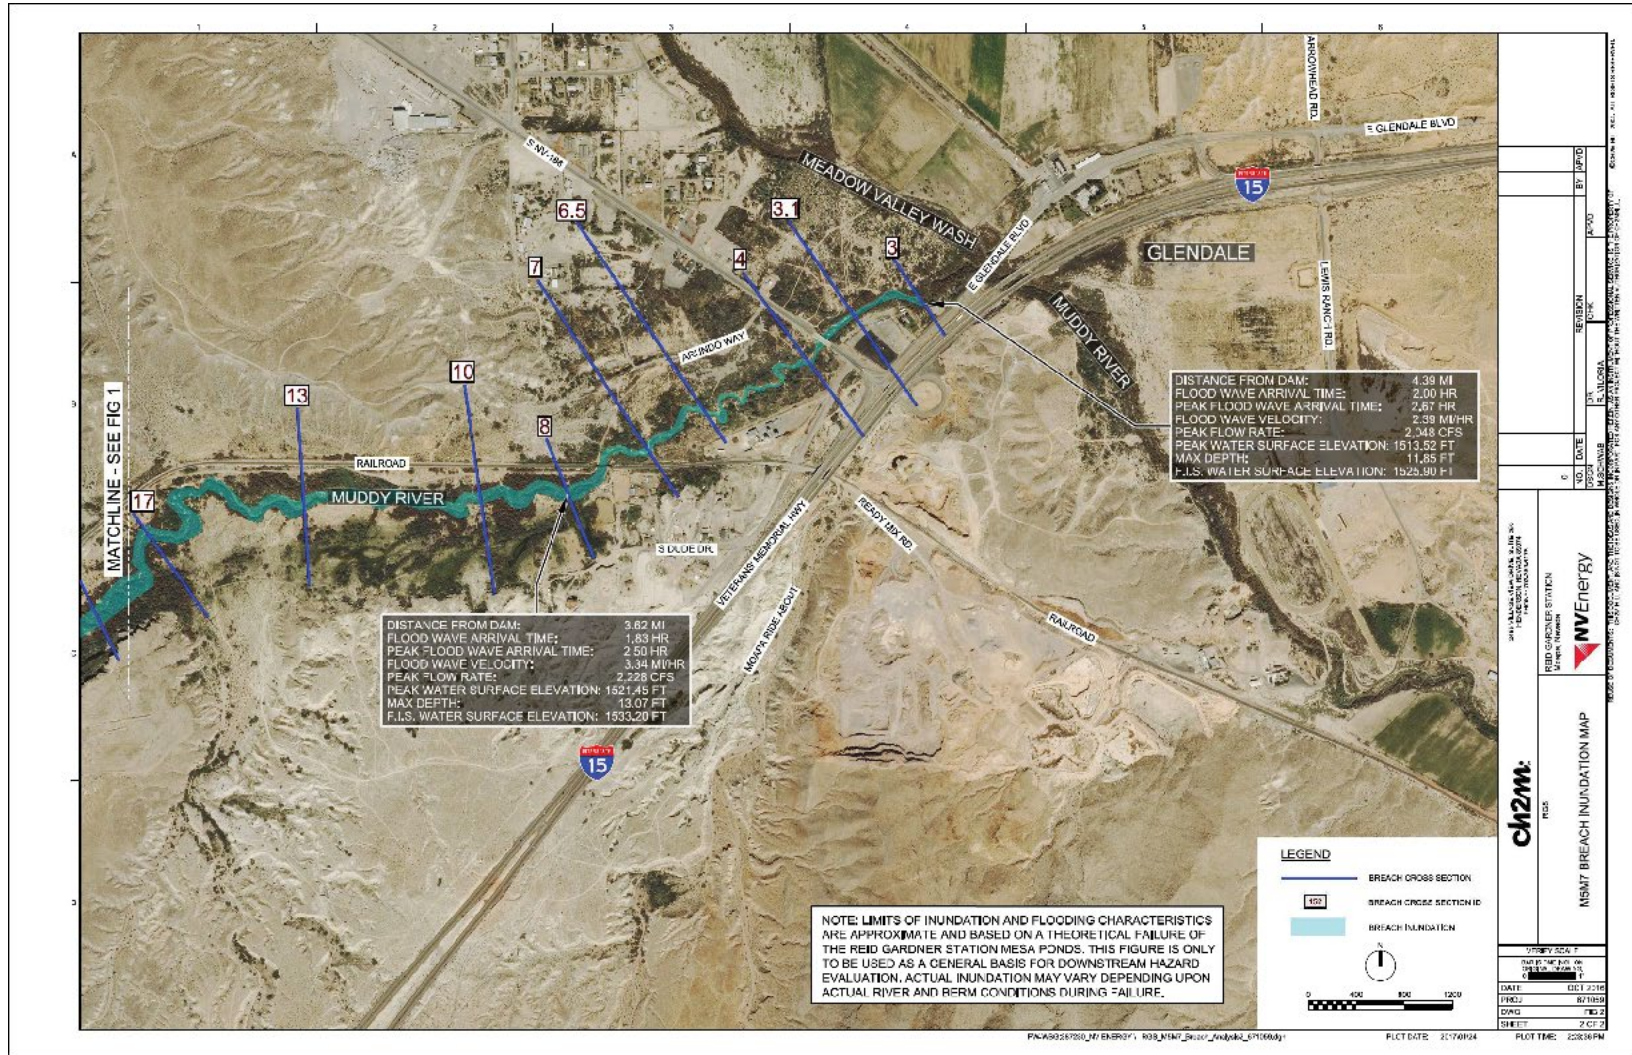

Ponds M5&M7 “Sunny Day” Dam Breach Analysis Results

36 mins

- time for leading edge of flood wave to reach the private residence where Hidden Valley Rd crosses the Muddy River

4,000 cfs

- Max flow at the private residence

5 ft.

- Max water elevation in dairy fields


1-2 ft.

- Max water elevation at private residence

2 river miles

- distance it takes to contain potential flood in the Muddy River banks.

4 Step Response Process

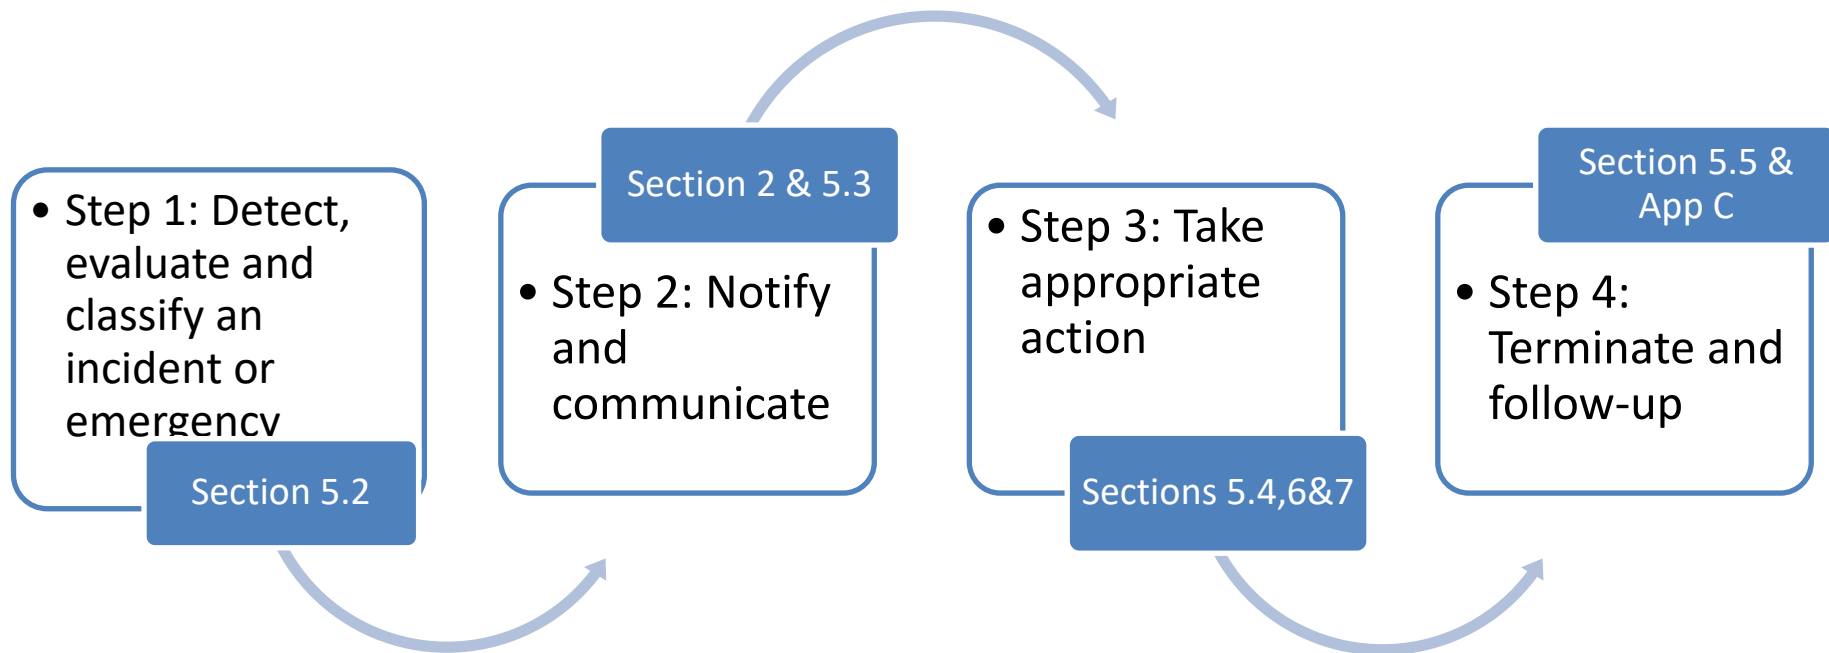

4 Step Process (Step 1)

Step 1: Detect, evaluate and classify an incident or emergency

Emergency Classifications:
Non-Failure, Potential Failure, Imminent Failure


Table 2-1. Emergency Level Determining Guidance

Risk	Emergency Level Determination Guidance	Emergency Level		
		Non-Failure	Potential Failure	Imminent Failure
Flooding	Not considered a likely event for M5/M7 ponds because of the location on Mesa and away from low-lying areas.	•		
Erosion	Incised areas close to the ponds	•		
Overtopping of top of the ponds	Water level is above maximum operational level, but more than 12 inches below the pond embankment	•		
	Water level within 12 inches of pond embankment		•	
	Erosion of embankment area by large overtopping waves			•
	Water level at or nearly at top of dam; water overtopping top of dam, with or without erosion			•
Seepage	New seepage area on or around the M5/M7 Ponds	•		
	New seepage area with cloudy discharge or increasing flow rate		•	
	Rapid flow rate increase with cloudy discharge from an existing seepage area			•
	New, small sand boil, whirlpool, rapid settlement, or sinkhole	•		
	Enlarging sand boil, whirlpool, settlement, or sinkhole – imminent failure if rapid		•	•
Embankment cracking	New cracks in the embankment, greater than 0.25-inch-wide, without seepage	•		
	Cracks in the embankment with seepage		•	
Embankment movement	Evidence of embankment slope movement (sliding, slumping, rotation, settlement)	•		
	Sudden or rapidly progressing slides of the embankment slopes			•
Earthquake	Earthquake felt at ponds M5/M7 or with Magnitude ≥ 4.0 reported within 30 miles	•		
	Earthquake resulting in visible damage to the M5/M7 Ponds		•	
	Earthquake resulting in uncontrolled release of water from the M5/M7 Ponds			•
Piping	Conveyance piping is inoperable or leaking	•		
	Damaged piping produces uncontrolled release of water into or from ponds		•	
Security threat	Demonstration or public protest that raises security threat levels	•		
	Verified bomb threat that, if carried out, could result in damage to the M5/M7 ponds		•	
	Detonated bomb that has resulted in damage to the M5/M7 Ponds			•
Sabotage/vandalism	Damage to the M5/M7 Ponds with no impact ponds function	•		
	Modification of M5/M7 Ponds that could adversely impact function	•		
	Damage to M5/M7 Ponds that has resulted in seepage flow		•	
	Damage to M5/M7 Ponds that has resulted in uncontrolled water release			•

4 Step Process (Step 2)

Step 2: Notify and Communicate

Based on the level of the emergency, notify parties using the notification flow chart in Section 2

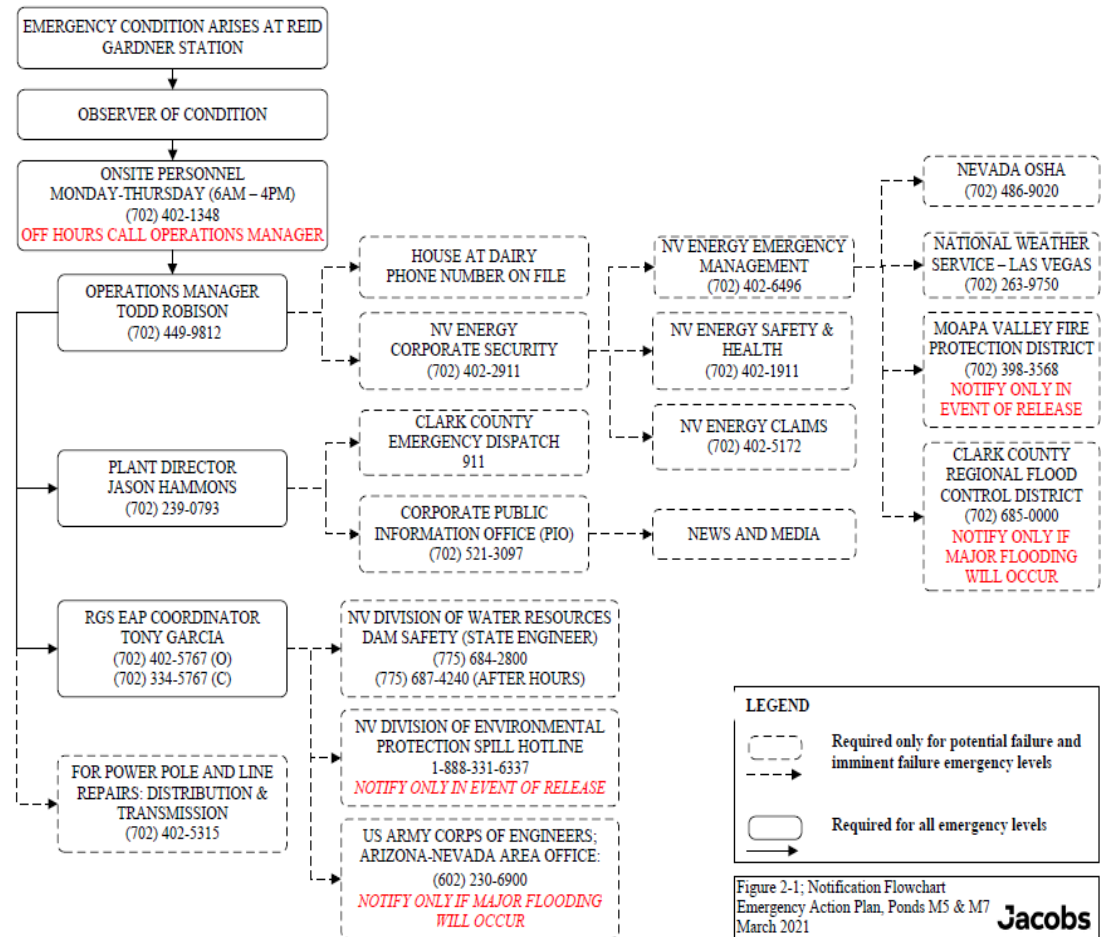



4 Step Process (Step 3)

Step 3: Take Emergency Action

- Prevent or delay dam failure
- Mitigate impacts if failure cannot be avoided.

Depending on the issue and potential level of failure, actions may include:

- Security issues: observe and notify corporate security
- Water level issues: monitoring berm conditions, control water levels and incoming flows,
- Berm integrity issues: reinforce/repair berms, placing traffic controls, initiating evacuation, employing methods to divert flow post failure.

Available Emergency Equipment

Quantity	Description
1	One-ton, 4x4 pickup
1	Half-ton, 4x4 pickup
1	Caterpillar 928 front-end loader
2	Bobcat skid steer loaders
1	Ranger rescue boat with 2-25 horsepower motors
4	All-terrain vehicles

4 Step Process (Step 4)

Step 4: Termination and Follow-Up

- Communicate with all previously-contacted parties (notification flowchart in Section 2)
- Post-event documentation
- Conduct supplemental evaluation of the EAP for its effectiveness and recommended improvements

Roles and Responsibilities

Incident Commander

- Ensures full response process is implemented during an event (Section 5)
- decides when to terminate an event

On-site Personnel

- Mitigate with corrective actions
- Monitor the dam and provide status updates

EAP Coordinator

- assist Incident Commander during emergencies
- provide training
- update documents

Dam Safety Engineer

- consult during emergencies
- conduct annual inspections
- assist with updating EAP

Emergency Management Authorities

- issue public warnings
- perform evacuations
- coordinate outside agency



CUSTOMER SERVICE



EMPLOYEE COMMITMENT



ENVIRONMENTAL RESPECT



OPERATIONAL EXCELLENCE



**BERKSHIRE
FINANCIAL STRENGTH
OWNERSHIP**

Questions?

