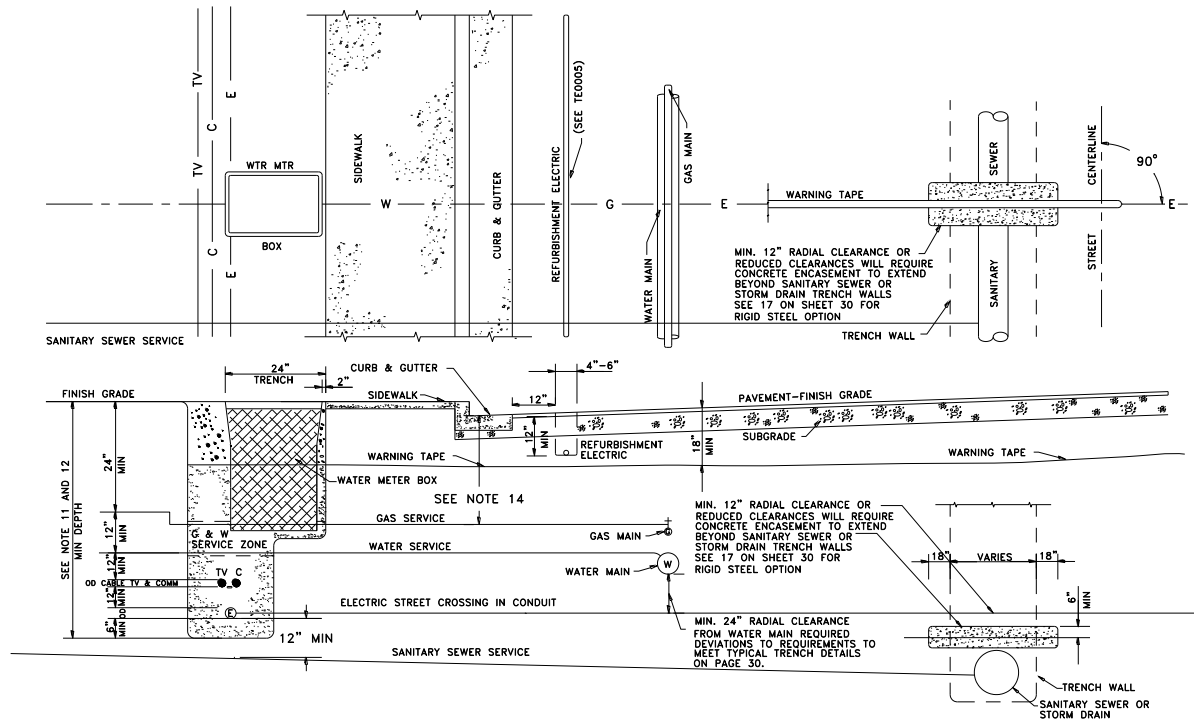

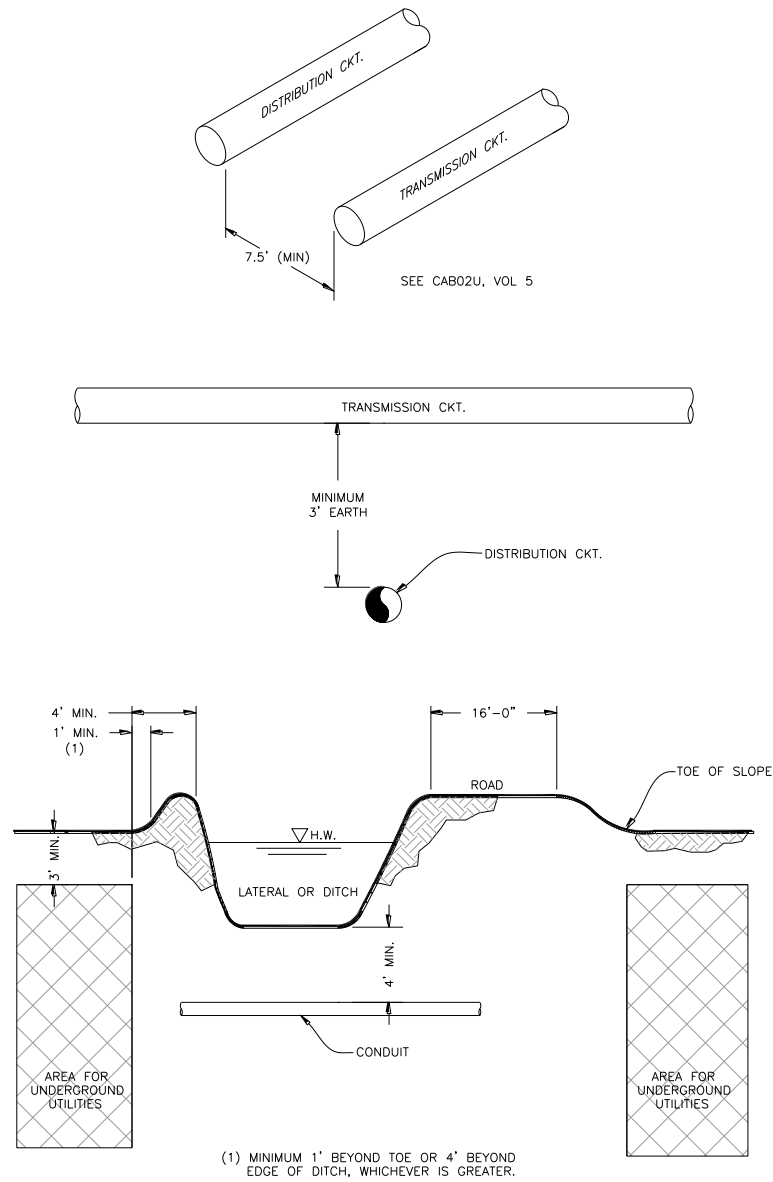



**CONSTRUCTION NOTES:**

- A. See TE0003U for typical trench details.
- B. See SUB01X for trench bedding and backfill specs.
- C. Electric to pass under Gas mains with min. 1' separation.
- D. Applicant to determine and stake finish grade.
- E. Comm/cable TV in conduit is allowed to cross over non-parallel gas services.
- F. Service stubs to cross main trench and over electric whenever possible.
- G. Conflict to facilities will be handled according to TE0003U 17 and 12-a.
- H. Electric may cross over any utility, when a minimum cover of, 50" for primary and, 38" for secondary / service only can be maintained, and a 12" minimum radial separations to all other facilities can be maintained. Note: gas must be above electric facilities and water needs a min of 24" radial separation.
- I. Gas and water to adjust depth of service to coincide with their zone at main trench depth measured from finish grade.



				VOLUME 17 – ENGINEERING AND CONSTRUCTION STANDARD		TE0004U
				STREET CROSSING AND UTILITIES LOCATION DETAIL		
Drawn:	Eng:	Appr:	Date:			Revision: 4
JVV	MB	DA	7/16			Page 1 of 2



				VOLUME 17 – ENGINEERING AND CONSTRUCTION STANDARD		TE0004U
				STREET CROSSING AND UTILITIES LOCATION DETAIL		
Drawn:	Eng:	Appr:	Date:	Revision: 4		
JVV	MB	DA	7/16			Page 2 of 2