



# ELECTRIC TRENCH / HYDRANT BYPASS DETAIL EXCEPTION SHOWN

**GENERALLY, HYDRANTS WILL BE LOCATED ON OPPOSITE  
SIDE OF STREET FROM ELECTRIC MAIN TRENCH.**

***Note:*** The 48" dimension may vary depending on PUE and R/W requirements. Please contact the local NVE office for exact details.

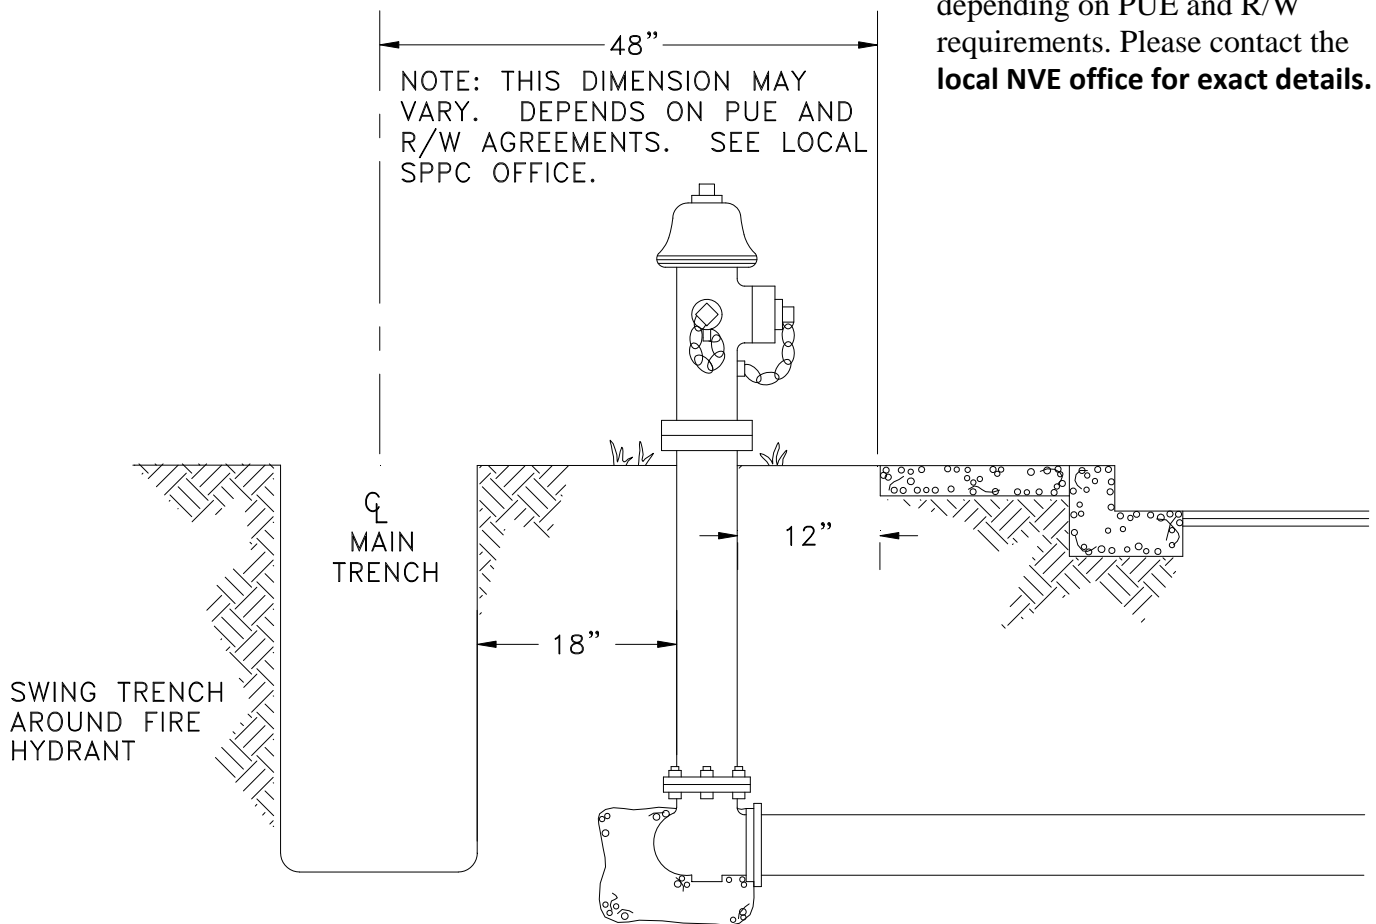

				VOLUME 17 – ENGINEERING & CONSTRUCTION STANDARD		TE0045U	
<b>ELECTRIC TRENCH HYDRATION BYPASS DETAIL</b>				Revision: 6		Page 1 of 1	
Drawn:	Eng:	Appr:	Date:				
JL	MB	DA	5/05				