
Metering Equipment: Installation Requirements

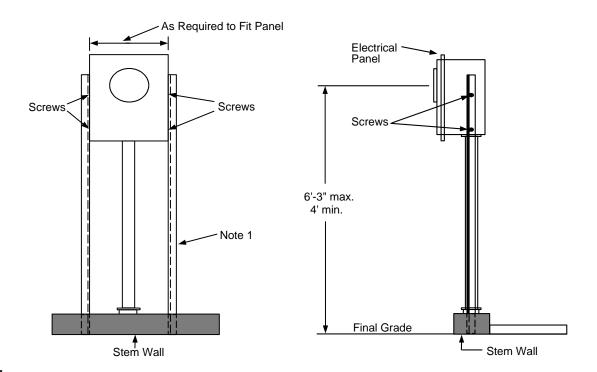

NOTES:

1. Framing shall be made of two 3-5/8" x 8' 18 GA. XC steel studs and secured to the panel by four 3/4" (max.) screws.

GENERAL NOTES:

- 1. Panels shall be installed according to section RPM of the ESR.
- 2. NVE inspector shall reserve the right to reject any installation.
- 3. NVE will not pull wire unless the framing for the wall containing the meter panel is erected or one of the other methods shown is properly installed, plumb and square.
- 4. The termination section cover shall be hinged, non-removable and sealable and have provisions for the installation of a securing screw on the front panel.

	NV	Ene	rav	Electric Service Requirements	RPI-3
	14 0	LITE	gy	Temporary Panel Stand	
Drawn:	Eng:	Appr:	Date:	Tomporary ranor otana	Revision: 1
MES	MES	DA	9/06		Page 1 of 2

THIS PAGE INTENTIONALLY LEFT BLANK

NV Energy					Electric Service Requirements	
		14 0	LHE	gy	Temporary Panel Stand	RPI-3
	Drawn:	Eng:	Appr:	Date:	Tomporary ranor otalia	Revision: 1
	MES	MES	DA	9/06		Page 2 of 2