
FOR MANUFACTURING REQUIREMENTS: REFER TO RPM-G, RPM-43, RPM-45, AND RPM-47

ALL DIMENSIONS SHOWN ARE IN INCHES

* Wall mounted termination applies to 0-800 Amps

* Floor mounted termination applies to all amperage ratings

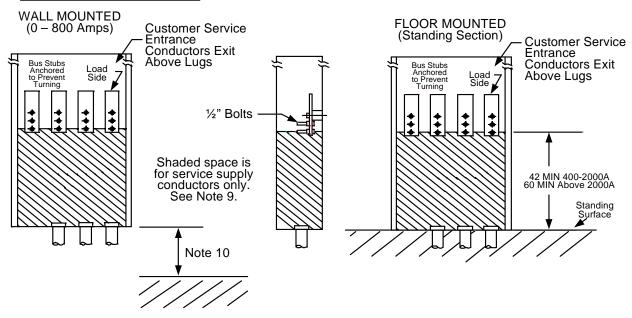

NOTES:

- 1. The termination section cover shall be independent of any part of the service panel other than the termination section.
- 2. The termination section shall be free of all earth and water pipe ground leads or connections (excluding grounding lug for conduit).
- 3. Load conductors shall leave box in area above the lugs.
- 4. For RGS or IMC riser conduit, a hub or bonding jumper is required for proper grounding of the conduit. A hub is the preferred method.
- 5. NVE termination crew-secure the termination section with a Mitey Lock security device.
- 6. All terminating sections shall have full front access. Cover panels shall be removable, sealable, provided with two lifting handles, and limited to a maximum size of 9 square feet in area.
- 7. The wall mounted panel shall be installed per RPI-24.
- 8. The multi-meter section shall be installed per RPI-28 (underground).
- 9. Customer-owned wiring shall not pass through any section sealed by NVE (this includes system grounds).
- 10. For 0-800 Amp service panels, a minimum 6" clearance between the standing surface and the service panel is required.
- 11. All cables to be sized in accordance with NEC and local building ordinances.
- 12. Consult with manufacturer for number of landing positions required. Typical design criteria is a maximum of 400 Amps per conductor for service with 0-1200 Amp rating.

| NV Energy | | | | Electric Service Requirements | RPI-12 |
|------------------|------|-------|-------|-----------------------------------|-------------|
| | | | | Service Panel Termination Section | |
| Drawn: | Eng: | Appr: | Date: | (Customer Owned Services Only) | Revision: 1 |
| DH | DH | DA | 12/06 | | Page 1 of 2 |

THIS PAGE INTENTIONALLY LEFT BLANK

| NV Energy | | | | | | | |
|------------------|------|-------|-------|--|--|--|--|
| Drawn: | Eng: | Appr: | Date: | | | | |
| DH | DH | DA | 12/06 | | | | |

Electric Service Requirements

Service Panel Termination Section (Customer Owned Services Only)

RPI-12

Revision: 1 Page 2 of 2