



# Metering Equipment: Installation Requirements

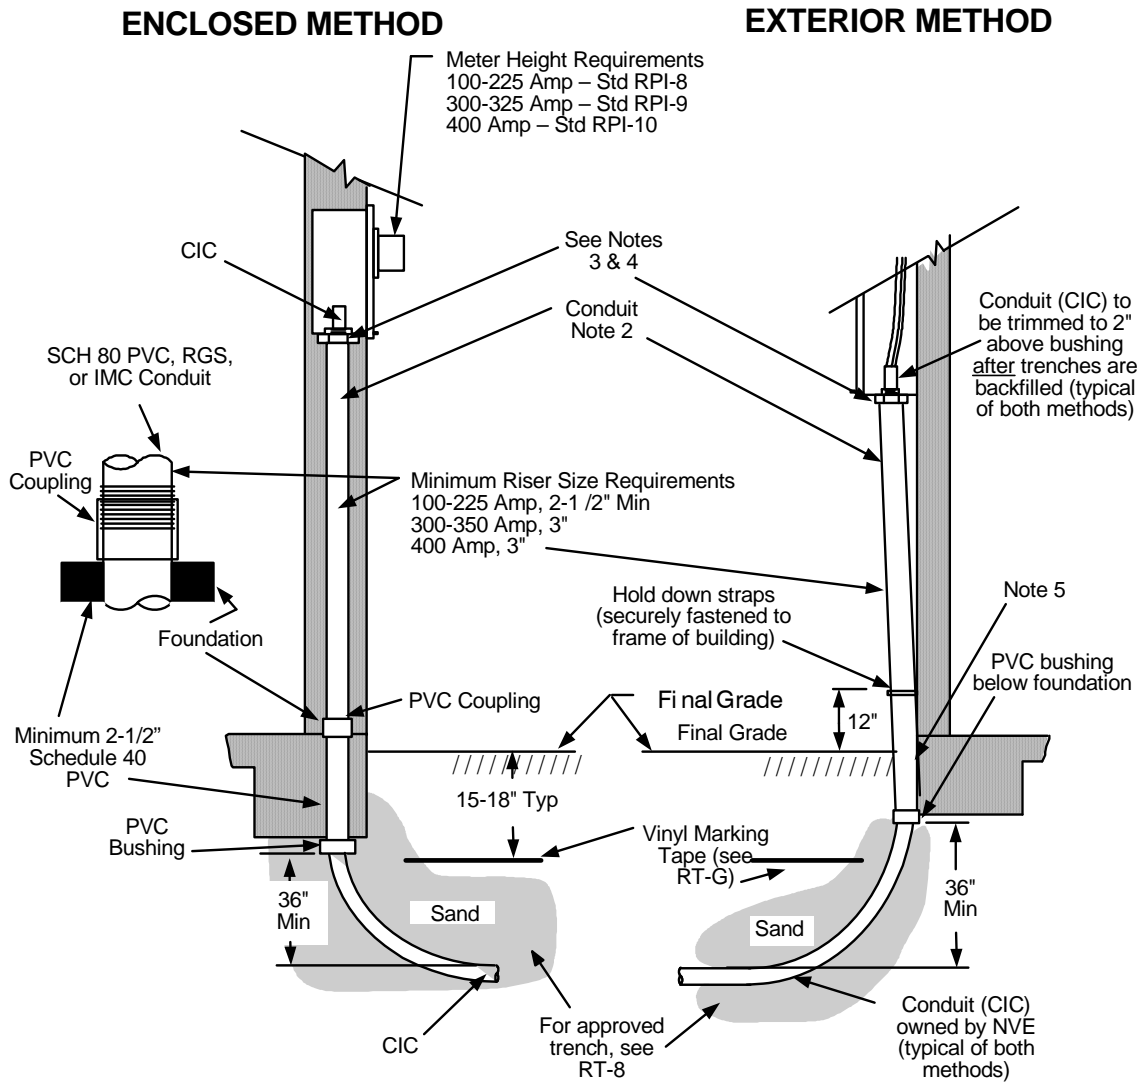


## SUBDIVISIONS, CUSTOM HOMES, AND TOWN HOUSES

### NOTES:

1. All installations shall meet the City, County, or State building codes.
2. Incoming conduit can be of rigid galvanized steel (RGS), intermediate metal conduit (IMC), or SCH 80 PVC. If SCH 80 PVC is used contractor must make sure trade size is clearly labeled and visible, showing SCH 80. If this cannot be done it will be **rejected**.
3. A plastic bushing is required on the panel end of the incoming conduit.
4. For the RGS or IMC conduit, a hub or bonding jumper is required for proper grounding of the conduit. A hub is the preferred method. (Per local building code)
5. All metal conduit exposed to the earth must be covered with 10 mil pipe protection tape, ½ lapped or PVC coating.
6. Kicks or Offsets shall not be permitted in service risers.
7. If contractor elects to hard stick service then they shall follow all applicable NEC codes and County codes in effect. This is above and beyond NVE standard installation.

				Electric Service Requirements		<b>RPI-23</b>
				<b>Cable Risers, Residential Single Meter, CIC, Underground</b>		
Drawn:	Eng:	Appr:	Date:			Revision: 4
DC	RD	DA	9/13			Page 1 of 2


# Metering Equipment: Installation Requirements

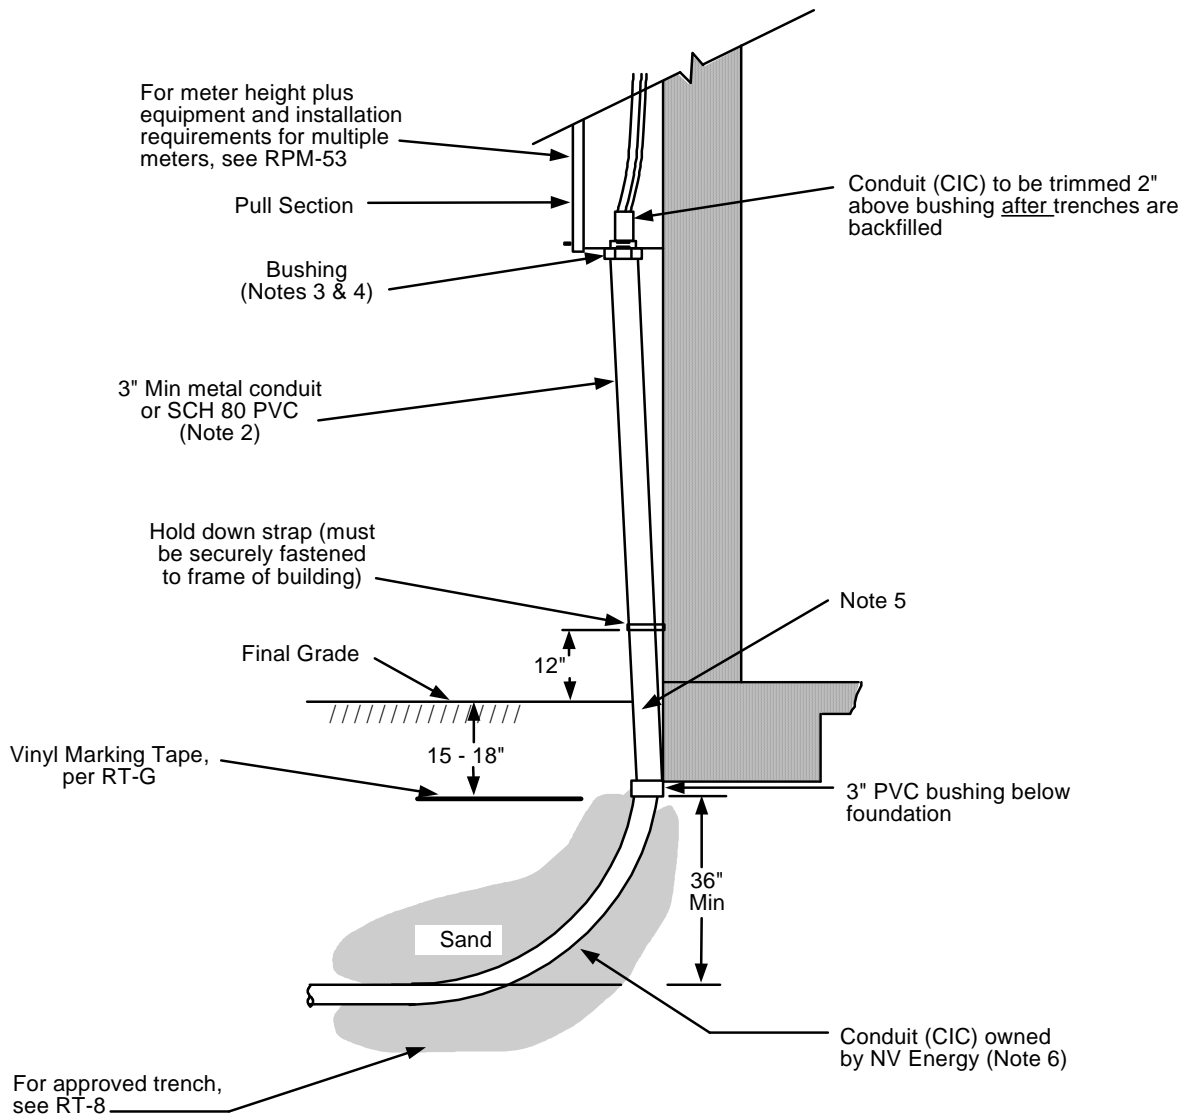

## APARTMENTS AND CONDOMINIUMS

### NOTES:

1. All installations shall meet the City, County, or State building codes.
2. The incoming conduit can be a rigid galvanized steel (RGS), intermediate metal conduit, or SCH 80 PVC. If SCH 80 PVC is used contractor must make sure trade size is clearly labeled and visible, showing SCH 80. If this cannot be done it will be **rejected**.
3. A plastic bushing is required on the panel end of the incoming conduit.
4. A hub or bonding jumper is required for proper grounding of the conduit. A hub is the preferred method (per local building code).
5. All metal conduit exposed to earth must be covered with 10 mil pipe protection tape, ½ lapped or PVC coating.
6. Kicks or Offsets shall not be permitted in service risers.
7. If contractor elects to hard stick service then they shall follow all applicable NEC codes and County codes in effect. This is above and beyond NVE standard installation.

				Electric Service Requirements		<b>RPI-23</b>
				<b>Cable Risers, Residential Single Meter, CIC, Underground</b>		
Drawn:	Eng:	Appr:	Date:			Revision: 4
DC	RD	DA	9/13			Page 2 of 2