



Metering Equipment: Installation Requirements

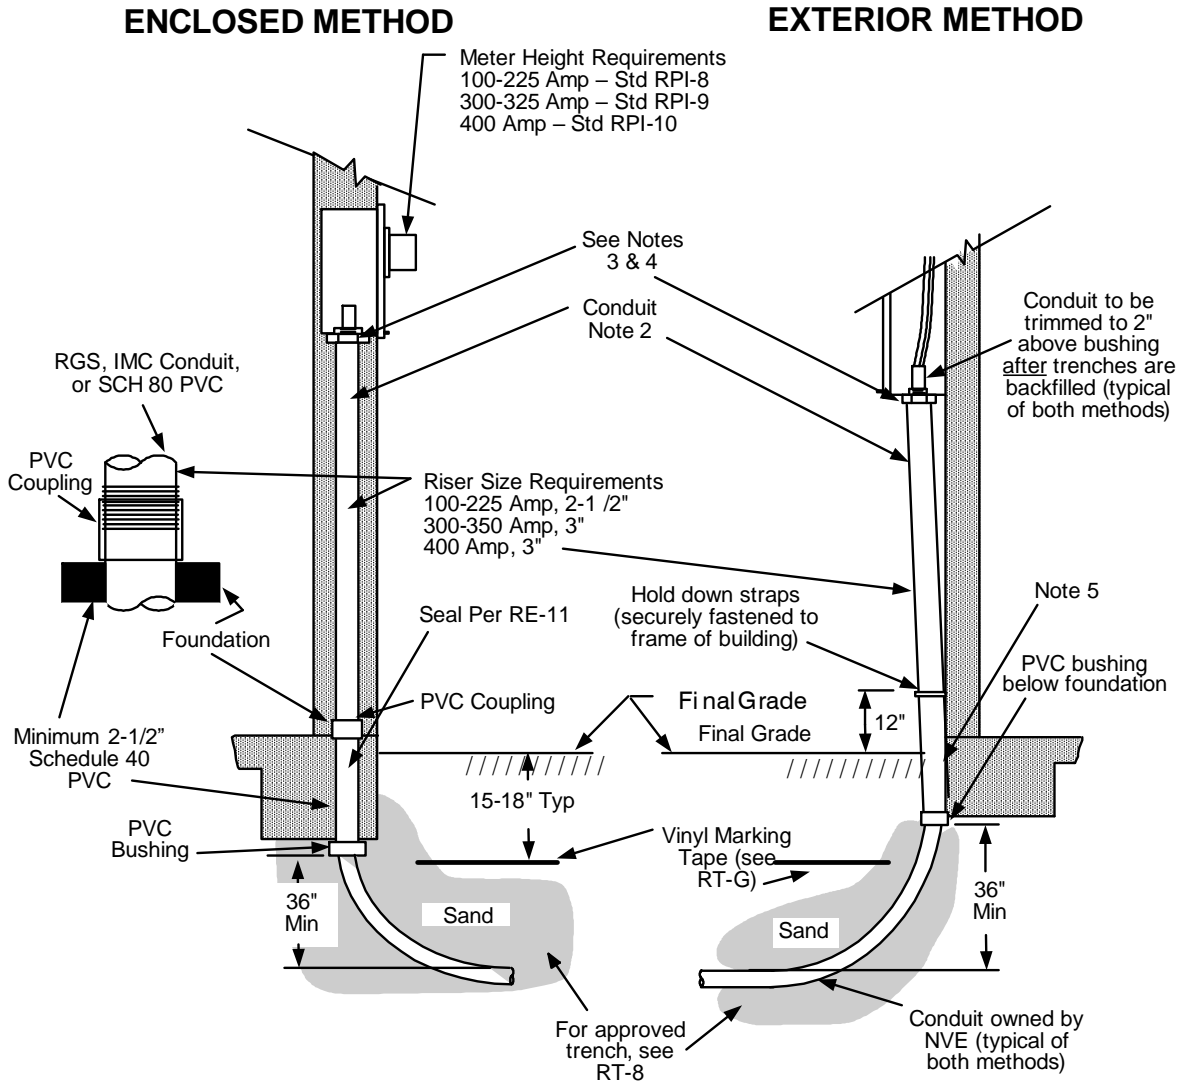


SUBDIVISIONS, CUSTOMER HOMES, AND TOWN HOUSES

NOTES:

1. All installations shall meet the City, County, or State building codes.
2. Incoming conduit can be of rigid galvanized steel (RGS), intermediate metal conduit (IMC), or SCH 80 PVC. If SCH 80 PVC is used contractor must make sure trade size is clearly labeled and visible, showing SCH 80. If this cannot be done it will be **rejected**.
3. A plastic bushing is required on the panel end of the incoming conduit.
4. For the RGS or IMC conduit, a hub or bonding jumper is required for proper grounding of the conduit. A hub is the preferred method (per local building code).
5. All metal conduit exposed to the earth must be covered with 10 mil pipe protection tape, ½ lapped or PVC coating.
6. Kicks or Offsets shall not be permitted in service risers.

				Electric Service Requirements		RPI-24
				Cable Risers, Commercial Multi-meter, NVE Cable, Underground		
Drawn:	Eng:	Appr:	Date:			Revision: 4
HT	JR	DA	10/18			Page 1 of 2


Metering Equipment: Installation Requirements

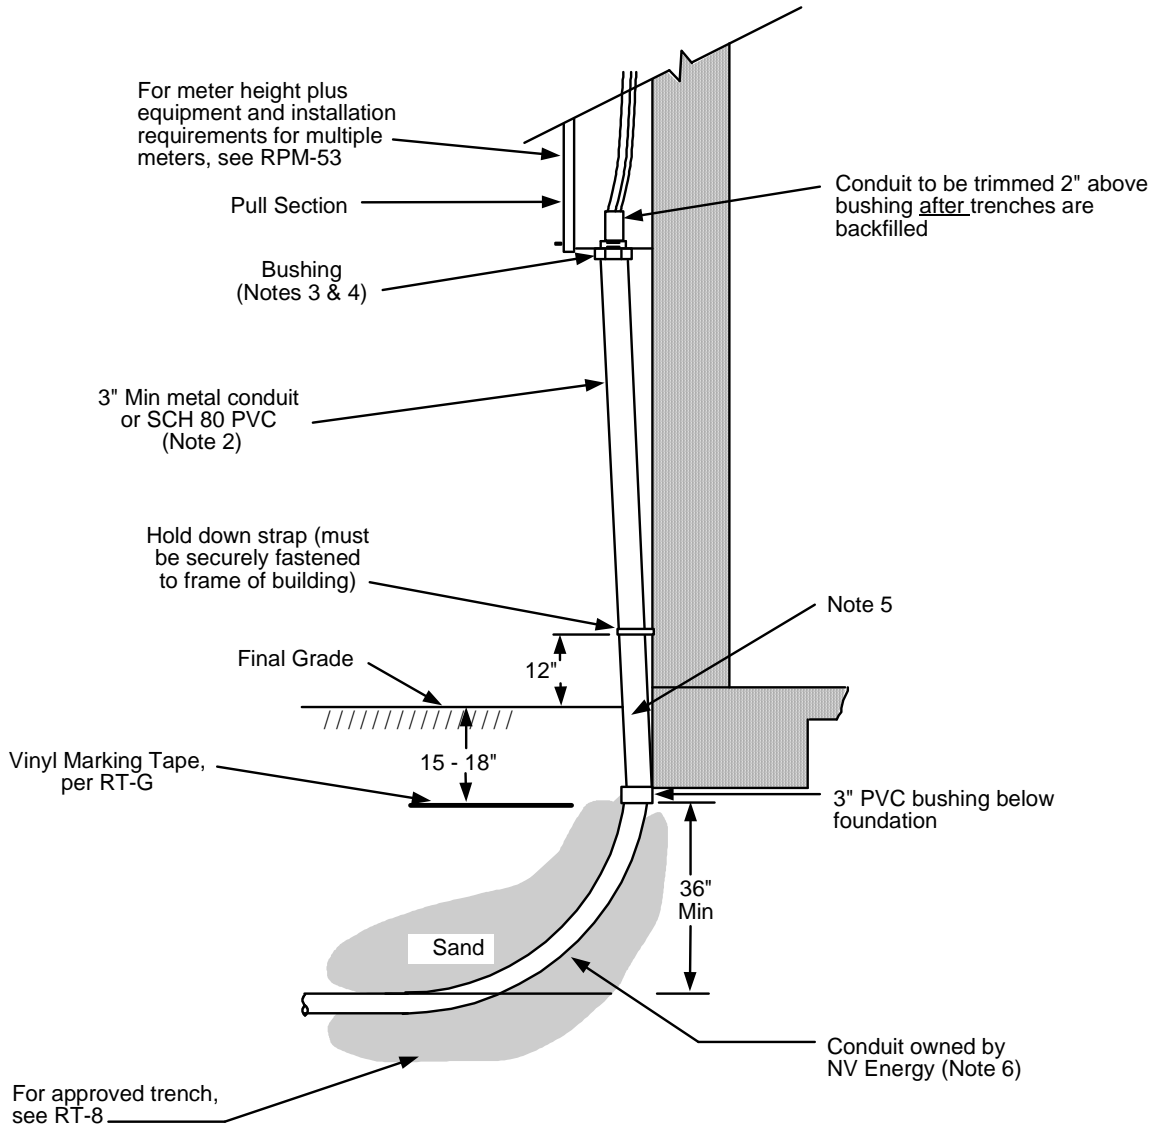

APARTMENTS AND CONDOMINIUMS

NOTES:

1. All installations shall meet the City, County, or State building codes.
2. The incoming conduit can be a rigid galvanized steel (RGS), intermediate metal conduit, or SCH 80 PVC. If SCH 80 PVC is used contractor must make sure trade size is clearly labeled and visible, showing SCH 80. If this cannot be done it will be **rejected**.
3. A plastic bushing is required on the panel end of the incoming conduit.
4. A hub or bonding jumper is required for proper grounding of the conduit. A hub is the preferred method (per local building code).
5. All metal conduit exposed to earth must be covered with 10 mil pipe protection tape, ½ lapped or PVC coating.
6. Kicks or Offsets shall not be permitted in service risers.

				Electric Service Requirements		RPI-24
				Cable Risers, Commercial Multi-meter, NVE Cable, Underground		
Drawn:	Eng:	Appr:	Date:			Revision: 4
HT	JR	DA	10/18			Page 2 of 2