



Metering Equipment: Material Requirements

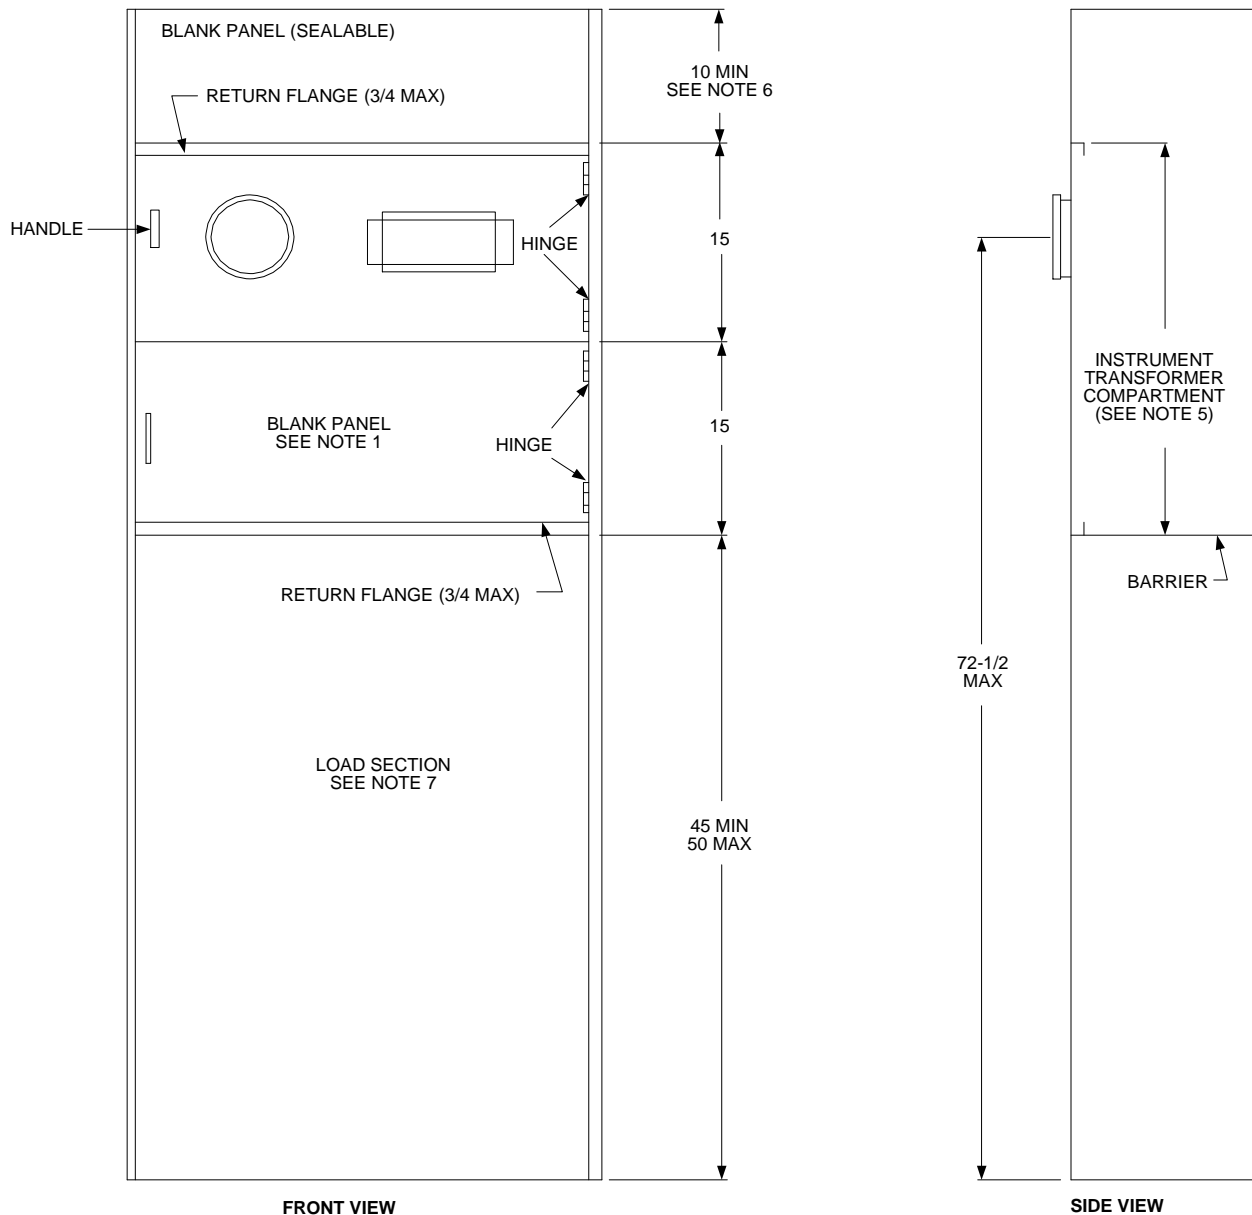

All Dimensions Shown are in Inches


NOTES:

1. Socket meter panel with blank meter panel shown. Consult Meter Department regarding alternate meter panel arrangements. Blank meter panel shall be constructed of 12 gauge (minimum) steel. See RPM-32 and RPM-33 for socket meter panel details.
2. Meter panels shall be equipped with stops to prevent inward swinging beyond the front surface of the service section.
3. Hinges shall be readily interchangeable, left or right, on the job site.

				Electric Service Requirements		RPM-25
				Standard Switchboard Service Section with Instrument Transformer Compartment		
Drawn:	Eng:	Appr:	Date:			Revision: 1
DH	DH	DA	1106			Page 1 of 2

Metering Equipment: Material Requirements

4. Removable or hinged panels enclosing unmetrated bus or cable shall be sealable. All securing screws shall be captive.
5. For requirements regarding instrument – transformer compartments, see:
 0-1000 Amps see RPM-19 and RPM-20.
 1001 – 3000 Amps see RPM-22
 3001 Amps and above see RPM-24
6. Dimension may be reduced if the service section is supplied from horizontal cross-bussing or bus duct.
7. When used as a utility terminating section in a bottom-fed service section, see; RPM-27, figure 3.
8. For outdoor applications, see RPM-54 for weatherproof enclosure requirements.

				Electric Service Requirements		RPM-25
				Standard Switchboard Service Section with Instrument Transformer Compartment		
Drawn:	Eng:	Appr:	Date:			Revision: 1
DH	DH	DA	1106			Page 2 of 2