



# Metering Equipment: Material Requirements

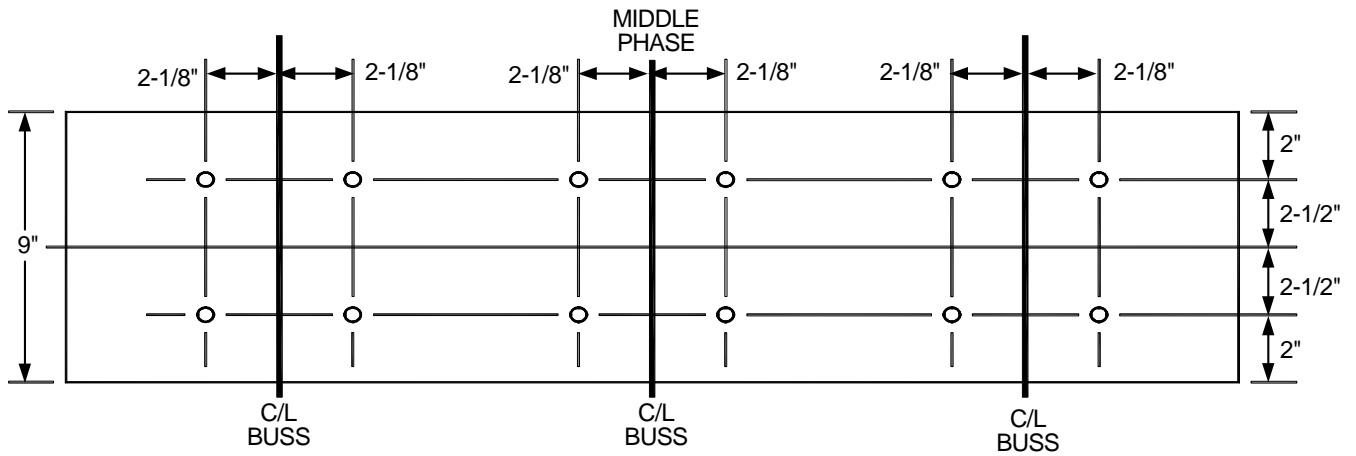


**CURRENT TRANSFORMER MOUNTING BASE**  
 NOTE: ALL HOLES TAP 3/8-16

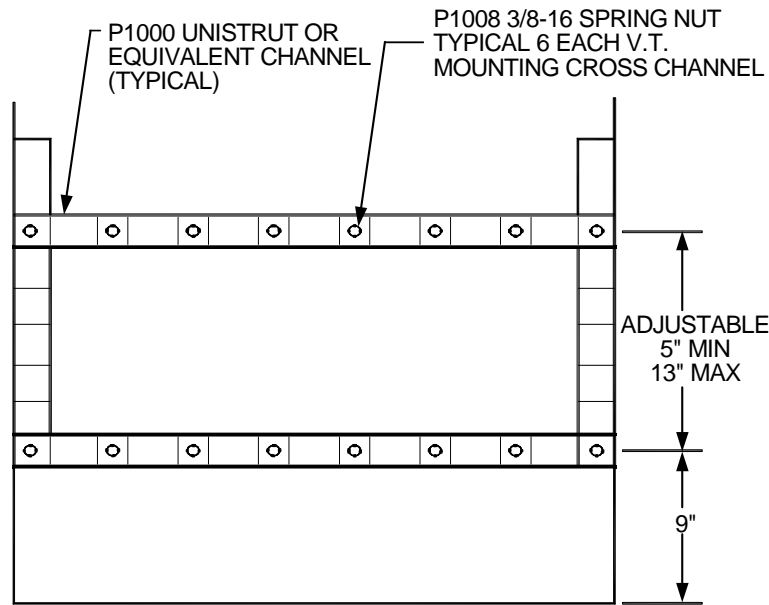


TOP VIEW OF COMPARTMENT

**VOLTAGE TRANSFORMER MOUNTING RAIL DETAIL**

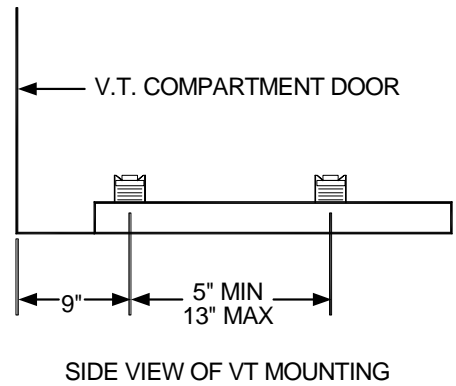


SIDE VIEW OF VT MOUNTING

				Electric Service Requirements		<b>RPM-402</b>
				<b>Mounting Pattern for Instrument Transformers: 2,400-27,000 Volt Service</b>		
Drawn:	Eng:	Appr:	Date:	Revision: 1		Page 1 of 2
DH	DH	MES	7/07			

# Metering Equipment: Material Requirements

---

THIS PAGE INTENTIONALLY LEFT BLANK

				Electric Service Requirements		RPM-402
				<b>Mounting Pattern for Instrument Transformers: 2,400-27,000 Volt Service</b>		
Drawn:	Eng:	Appr:	Date:	Revision: 1		
DH	DH	MES	7/07	Page 2 of 2		