


Equipment Pads

DESIGN REQUIREMENTS

TOLERANCES: REBAR SCHEDULE:

- a = +0", -1-1/2"
 b = +1/4", -0"
 c = +0", -1/4"
 d = +1/2", -0"
 (a) = 13 ea. 90"
 (b) = 4 ea. 53"
 (c) = 2 ea. 24"
 (d) = 6 ea. 12"
 (e) = 4 ea. 6"

APPROVED PADS	
MANUFACTURER	PAD
Jensen Precast	J-RS-37

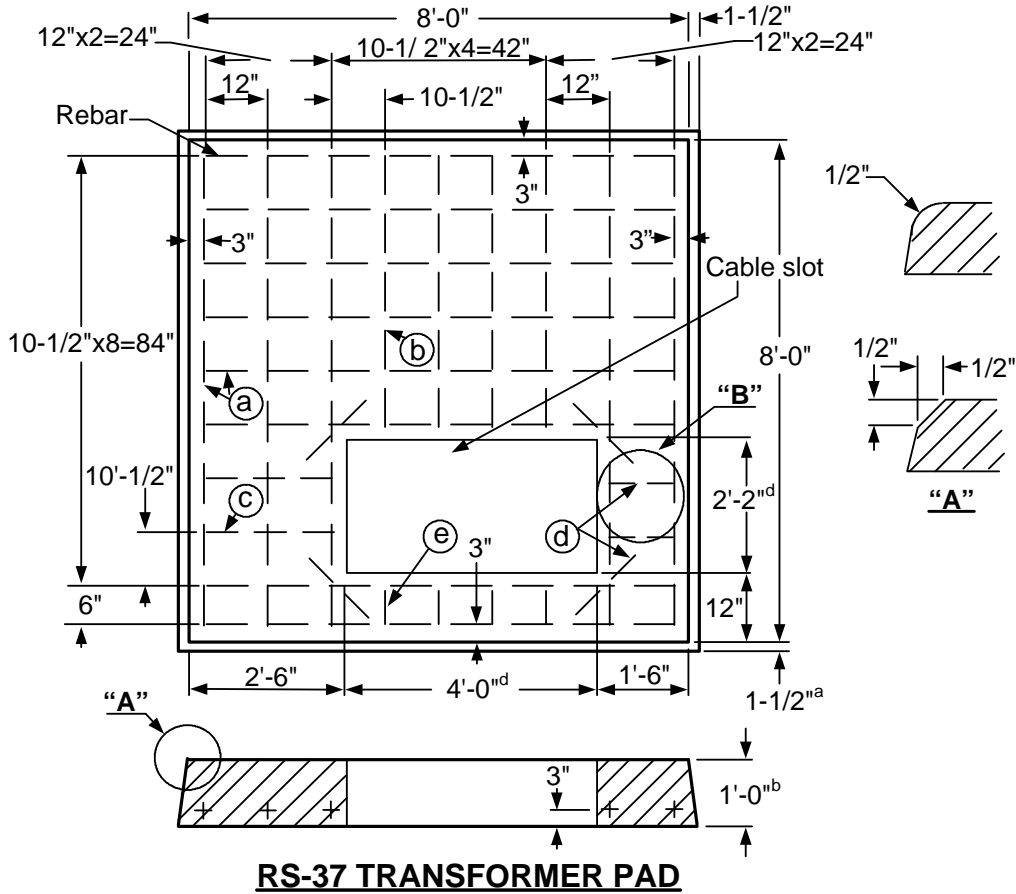


- Rebar
 - Minimum #4
 - Placed into the above drawing according to the rebar schedule.
- Pad
 - A 26" x 48" cable slot.
 - Shall meet RS-G2 and RS-G3.
- Only the RSI-39 Pad
 - Two 2-1/2" x 2-1/2" x 1/4" min. x 66" hot dip galvanized steel angle.
 - A 1" diameter PVC ell with a minimum radius 5-3/4".
 - A 1" diameter PVC coupling.

	Electric Service Requirements			RS-37
	Transformer Pad:			
3 Ph, 12/25KV 500-1000KVA @208V, 1000-2500KVA @480V				Revision: 2A
Drawn:	Eng:	Appr:	Date:	Page 1 of 2
JR	RD	DA	9/15	

Equipment Pads

INSTALLATION REQUIREMENTS

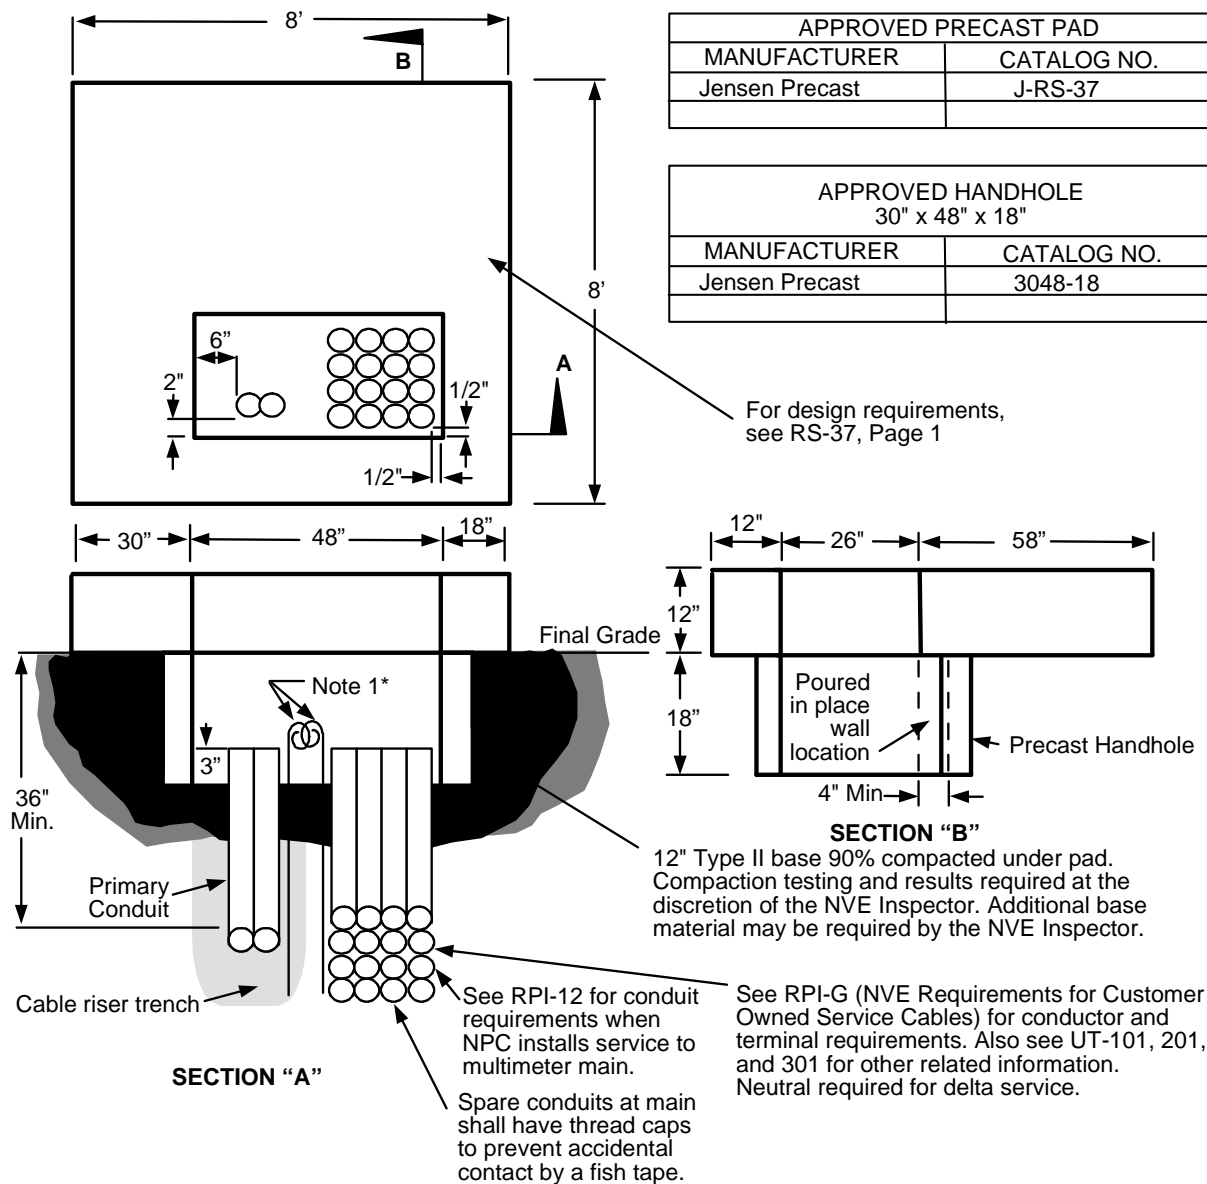

NOTES:

1. Grounding by customer shall be 2-50' #2 stranded bare copper ground wires laid in the bottom of the trench in opposite directions with 2-5' tails in the pad opening.
 2. For location and clearances to other structures, see RS-5.
 3. Retaining wall required when grade from bottom of pad rises or lowers more than 1' in 5' horizontally.
 4. All secondary conduits shall be located within 24" of the right side of the pad opening.
 5. The top of the pad shall be leveled and must clear the final grade by 12".
- * Only at the discretion of NVE's inspectors and T&D Standards, a 1/2"x8' copper ground rod can be installed in accordance with the 2012 NESC C2-2012 Section 9, Grounding Methods for Electric Supply and Communications Facilities or latest version.

	Electric Service Requirements			RS-37
	Transformer Pad: 3 Ph, 12/25KV 500-1000KVA @208V, 1000-2500KVA @480V			
Drawn:	Eng:	Appr:	Date:	Revision: 2A
JR	RD	DA	9/15	Page 2 of 2